

2021-2022 Compliance Calendar for Gasoline Dispensing Facilities



**Created by the Wisconsin Small Business
Environmental Assistance Program**



Welcome!

Welcome to the 2021-2022 edition of the compliance calendar for gas stations and other gasoline dispensing facilities. The Wisconsin Small Business Environmental Assistance Program (SBEAP) developed this calendar to help gasoline dispensing facilities comply with environmental requirements related to the transfer of fuel. This calendar can be a useful tracking and record keeping tool for facilities.

This calendar summarizes the requirements under three sets of regulations affecting gas stations. However, please refer to the official rule language for more comprehensive information about them:

How to contact the program:

Small Business Environmental Assistance Program

WI Dept. of Natural Resources
Sustainability and Business
Support EA/7
101 S. Webster St.
PO Box 7921
Madison, WI 53707-7921

855-889-3021 (toll free)
DNRsmallbusiness@wi.gov

<http://dnr.wi.gov/>, search "small
business assistance"

- **U.S. Environmental Protection Agency** (U.S. EPA) standards for gasoline dispensing facilities: <https://www.epa.gov/stationary-sources-air-pollution/gasoline-distribution-mact-and-gact-national-emission-standards>,
- **Wisconsin Department of Natural Resources** (DNR) regulations regarding emissions of gasoline vapor from petroleum and gasoline sources: https://docs.legis.wisconsin.gov/code/admin_code/nr/400/420 and https://docs.legis.wisconsin.gov/code/admin_code/nr/400/445/title, and
- **Wisconsin Department of Agriculture, Trade & Consumer Protection** (DATCP) regulations for gasoline storage tanks and piping: https://docs.legis.wisconsin.gov/code/admin_code/atcp/090/93.

This calendar was designed to provide space for recording gasoline throughput, inventory tracking, leak detection inspections, repairs and employee training. **Keep the completed calendar on file for five years, and it can serve as the facility's official record.**

The 2021-2022 calendar has been updated to reflect the following changes:

- **Throughput - 12 Month Rolling Total**—New table on **page 61** to help demonstrate compliance with NR 445.
- **Monthly walkthrough inspections**—Now required to be performed or reviewed by the facility's Class B operator. An "inspected by" row has been added to the walkthrough recordkeeping table on **page 56**.
- **Pipe connections**—Must be in secondary containment by January 1, 2022. See **page 75**.
- **DNR website**—Changes have been made to DNR's website. Visit <http://dnr.wi.gov>, search "gas stations" for updated links.



About the Small Business Environmental Assistance Program (SBEAP)

SBEAP is a free, non-regulatory program that provides information to Wisconsin's small businesses to help them understand their environmental compliance requirements. The program provides factsheets, record keeping and reporting tools, U.S. EPA and DNR compliance documents, required forms and much more. All are available free of charge. For questions or comments about this calendar or to obtain additional copies, please contact SBEAP.

Wisconsin Compliance Calendar for Gasoline Dispensing Facilities

Table of Contents

Introduction

- Understanding the Regulations Affecting Gas Stations and How this Calendar Can Help 4

Record Keeping Tools

- Instructions for Using the Record Keeping Pages 6
- 2021-2022 Calendar and Record Keeping Pages 8
- Monthly Walkthrough & Inspection Checklist 56
- Weekly Inspection Checklist 58
- Training Logs 59
- Gasoline Inventory Tracking & Verification Worksheet 60
- Throughput - 12 Month Rolling Totals 61

Fact sheets

- Introduction to Vapor Recovery 62
- National Emission Standards for Hazardous Air Pollutants for Gasoline Dispensing Facilities (NESHAP) 63
- Wisconsin's Regulation for Control of Organic Compound Emissions from Petroleum and Gasoline Sources 66
 - ◆ Stage II Decommissioning Checklist 70
- Wisconsin's Flammable, Combustible and Hazardous Liquids Rule (Underground Storage Tank Requirements) 71
 - ◆ Owner-Operator Training Requirements 77
- Spill Reporting Requirements and Procedures 79
- Definitions 80

Additional Resources

- Sources of Information 82
- Petroleum Inspection Districts Map & Contact Information 83
- Assistance Available for Gasoline Dispensing Facilities back cover

Understanding the Regulations Affecting Gas Stations and How this Calendar Can Help

Gasoline vapors contain volatile organic compounds (VOCs) and several hazardous air pollutants (HAPs), such as benzene. Filling gasoline storage tanks can release these compounds to the air. Benzene, for example, is among the 30 HAPs identified as posing the greatest public health risk in urban areas. Exposure to benzene can cause drowsiness, dizziness and even unconsciousness. Long term exposure to benzene can cause anemia and leukemia.

Leak detection and vapor control are among the methods that gasoline dispensing facilities use to reduce the emissions of HAPs like benzene into the air.

In Wisconsin, gas stations and other gasoline dispensing facilities are affected by various regulations such as:

- U.S. Environmental Protection Agency (U.S. EPA) **National Emission Standards for Hazardous Air Pollutants** for gasoline dispensing facilities (NESHAP; 40 CFR part 63, subpart CCCCCC). This rule regulates vapor control during the filling of gasoline storage tanks.
- Wisconsin Department of Natural Resources (DNR) regulations regarding **Control of Organic Compound Emissions from Petroleum and Gasoline Sources** (ch. NR 420, *Wis. Adm. Code*). This rule requires vapor control during the filling of gasoline storage tanks (Stage I vapor recovery) in some Wisconsin counties. Vapor control during the refueling of motor vehicles (Stage II vapor recovery) is no longer required, as many vehicles today are equipped with onboard vapor recovery systems.
- Wisconsin Department of Agriculture, Trade & Consumer Protection (DATCP) **Regulations for Flammable, Combustible and Hazardous Liquids** (ch. ATCP 93, *Wis. Adm. Code*). This rule regulates gasoline storage tanks and associated piping.

Who is affected by these regulations?

The U.S. EPA regulations affect “area sources” which include all gasoline dispensing facilities that emit less than 10 tons per year of a single HAP or less than 25 tons per year of any combination of HAPs. Most gas stations fall into this group.

The DNR’s emissions regulations mainly affect facilities located in 20 Wisconsin counties (Brown, Calumet, Dane, Dodge, Door, Fond du Lac, Jefferson, Kenosha, Kewaunee, Manitowoc, Milwaukee, Outagamie, Ozaukee, Racine, Rock, Sheboygan, Walworth, Washington, Waukesha and Winnebago counties). Depending on the size of their storage tanks, gas stations in these counties may be required to employ Stage I vapor control systems. See the information on this rule, starting on **page 66**, for details.

Wisconsin’s regulations for flammable, combustible and hazardous liquids (ATCP 93) affect businesses that sell gasoline or other liquid motor fuels. Most gas stations with gasoline storage tanks are affected by this rule.

What is required?

The regulations generally address the following goals:

- **Minimize releases of gasoline vapor from storage tanks** - All gasoline dispensing facilities, regardless of size, must implement management practices that minimize vapor releases to the atmosphere. The particular vapor control requirements that apply to each facility may depend on the amount of gasoline dispensed at the facility.
- **Minimize leaks (of liquid gasoline from gasoline storage tanks, piping, and dispensing equipment)** - The regulations for minimizing gasoline leaks require regular inspections to monitor equipment function and leak checks for rapid detection of any leaks in the equipment.
- **Testing and compliance demonstration** - Some facilities are required to test the vapor balance system and equipment to demonstrate compliance with regulations. In addition, facilities may be required to measure the leak rate and cracking pressure of pressure-vacuum vent valves on gasoline storage tanks.
- **Record keeping and reporting** - Record keeping requirements include tracking and verifying gasoline inventory, keeping records of regular equipment tests and keeping records of any required employee training. Some facilities may also be required to file “Initial Notification” and “Notification of Compliance Status” reports.

What can this calendar do?

This calendar has been designed to help gasoline dispensing facilities comply with the regulations, especially tracking and meeting record keeping obligations. The calendar can be used to:

Assess applicability

The fact sheets located at the back of the calendar, starting on **page 62**, can help identify which requirements apply to a facility and how the facility is affected. However, they are not a substitute for reading and understanding the rules. Refer to the rule language for additional information and clarification.

Contact information for the regulatory agencies and other offices, as well as resources that can assist with the requirements, are also provided starting on **page 82**.

Record important dates

Facilities can use the monthly calendar, starting on **page 8**, to keep track of any important dates. Mark the calendar when tank-use permits are due, when tank insurance is due and when equipment testing is required.

Document inspections and leak-detection monitoring

Each month of the calendar contains space where facilities can track their inspections and keep a maintenance and repair log for equipment. Sample checklists for monthly and weekly inspections are also provided starting on **page 56**.

Document employee training

The log on **page 59** can help document required and recommended employee training.

Document inventory tracking and verification

Page 60 contains a sample worksheet for recording daily gasoline inventory, and **page 61** has a worksheet for calculating 12 month rolling totals for throughput. In addition, each month provides space to summarize the total amounts of gasoline delivered and dispensed.

Maintain an official record

If a facility saves their completed calendar, it can serve as part of their official record. Keep this and other records at the facility for five years to demonstrate compliance.

Why must gas stations inspect storage tanks and equipment?

Properly installed and maintained underground storage system equipment is durable and reliable. However, daily wear and tear; exposure to corrosive effects of soil, water and stored product; and seasonal extremes of heat and cold can degrade or damage storage system components and cause product releases or equipment failure. The purpose of inspections is to identify any noticeable deterioration or apparent malfunction in the portion of the equipment visible beneath grade-level access covers located over or near the top of the underground storage tank and at the fuel dispensers.

Required regular inspections help protect the public, facility employees and the environment from the hazards posed by the release of flammable or combustible liquids and exposure to toxic motor fuels. Facilities can also save money by identifying and repairing leaks of stored fuel.

Why is leak detection important?

Leak detection can help businesses in numerous ways. Among other things, leak detection can:

- reduce or eliminate loss of product (from theft or leaks)
- reduce fire and explosion threats
- reduce and/or eliminate contamination of soil, groundwater, streams, rivers, lakes and drinking water
- reduce liability

Please contact SBEAP with any suggestions for additions or modifications that will make this calendar more helpful. Thank you!

Wisconsin Small Business Environmental Assistance Program

Instructions for Using the Record Keeping Pages in this Calendar

Attach monthly inventory worksheet(s) or printout(s) here

Monthly inventory worksheets or automatic tank gauging (ATG) strips can be kept with this calendar. Attach them to the record keeping page for each month.

Each month, check for any deadlines approaching for permit renewal, tank insurance, compliance testing and employee training. Set a reminder to meet all important dates and deadlines by marking the calendar.

| Reminders – Permits, Insurance, Testing and Training | | |
|---|-----|----|
| Are tank permits up to date? | Yes | No |
| Is tank insurance due this month? | Yes | No |
| Is equipment testing due this month? Are most recent test results on site? | Yes | No |
| Is all training up to date for current employees? | Yes | No |

Use this table to keep a record of required monthly inspections. Read the complete “Monthly Inspection Checklist” on **page 56** and record inspection results for each month on this table. Each person who conducts an inspection should initial their entries.

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

Use this table to summarize the monthly gasoline throughput at the facility. For each tank (or product), record the total amount of gasoline delivered to and dispensed from that tank during the month. Mark yes if the tank is within the allowable variance for the month (if using inventory control). For more information about inventory recording and verification, and for help with the calculations, see the worksheet on **page 60** of this calendar. Another table on **page 61** can be used to track throughput 12 month rolling totals.

Facilities that choose to retain Stage II systems can use this table to keep a log of their weekly inspections (weekly inspections of Stage II equipment are optional but recommended - see **page 66**). Record the date of each weekly inspection. The person who conducts the inspection should initial the table.

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

Use this table to help meet the requirement to keep a system maintenance and repair log. Record the date when inspections are conducted and the name of the person who inspected the equipment. Also record information about any problem or defective part discovered, the date the equipment was repaired, and the manufacturer and part number of any parts replaced. Alternatively, documentation of repairs may be kept in a separate file. This table can be used to record the date of repairs and note the location where the complete explanation and record is stored.

Attach monthly inventory worksheet(s) or printout(s) here

January 2021

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Reminders - Permits, Insurance, Testing and Training | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

January 2021

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|--|--------|---------|-----------|----------|-----------------------------|----------|
| <p>Need reminders of any deadlines this month? Mark this calendar!</p> <p>Questions? Call 855-889-3021</p> | | | | | 1 Weekly Inspection | 2 |
| 3 | 4 | 5 | 6 | 7 | 8 Weekly Inspection | 9 |
| 10 | 11 | 12 | 13 | 14 | 15 Weekly Inspection | 16 |
| 17 | 18 | 19 | 20 | 21 | 22 Weekly Inspection | 23 |
| 24/31 Monthly Inventory Monthly Inspection | 25 | 26 | 27 | 28 | 29 Weekly Inspection | 30 |

Attach monthly inventory worksheet(s) or printout(s) here

February 2021


| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Reminders - Permits, Insurance, Testing and Training | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

February 2021

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|---|---|---------|-----------|----------|-------------------------|----------|
| | 1 | 2 | 3 | 4 | 5 Weekly Inspection | 6 |
| 7 | 8 | 9 | 10 | 11 | 12 Weekly Inspection | 13 |
| 14 | 15 | 16 | 17 | 18 | 19 Weekly Inspection | 20 |
| 21 | 22 | 23 | 24 | 25 | 26 Weekly Inspection | 27 |
| 28 Monthly Inventory Monthly Inspection | Need reminders of any deadlines this month? Mark this calendar! Questions? Call 855-889-3021 | | | | | |

Attach monthly inventory worksheet(s) or printout(s) here

March 2021


| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Reminders - Permits, Insurance, Testing and Training | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

March 2021

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|--------|--------|---------|---|--|-----------------------------|----------|
| | 1 | 2 | 3 | 4 | 5 Weekly Inspection | 6 |
| 7 | 8 | 9 | 10 | 11 | 12 Weekly Inspection | 13 |
| 14 | 15 | 16 | 17 | 18 | 19 Weekly Inspection | 20 |
| 21 | 22 | 23 | 24 | 25 | 26 Weekly Inspection | 27 |
| 28 | 29 | 30 | 31 Monthly Inventory Monthly Inspection | <p>Need reminders of any deadlines this month? Mark this calendar! Questions? Call 855-889-3021</p> | | |

Attach monthly inventory worksheet(s) or printout(s) here

April 2021

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Reminders - Permits, Insurance, Testing and Training | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

April 2021

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|---|--------|---------|-----------|----------|---|----------|
| Need reminders of any deadlines this month? Mark this calendar! Questions? Call 855-889-3021 | | | | 1 | 2 Weekly Inspection | 3 |
| 4 | 5 | 6 | 7 | 8 | 9 Weekly Inspection | 10 |
| 11 | 12 | 13 | 14 | 15 | 16 Weekly Inspection | 17 |
| 18 | 19 | 20 | 21 | 22 | 23 Weekly Inspection | 24 |
| 25 | 26 | 27 | 28 | 29 | 30 Monthly Inventory Monthly Inspection | |

Attach monthly inventory worksheet(s) or printout(s) here

May 2021

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Reminders - Permits, Insurance, Testing and Training | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

May 2021

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|--|---|---------|-----------|----------|-------------------|----------|
| <p>Need reminders of any deadlines this month? Mark this calendar!</p> <p>Questions? Call 855-889-3021</p> | | | | | | 1 |
| 2 | 3 | 4 | 5 | 6 | 7 | 8 |
| | | | | | Weekly Inspection | |
| 9 | 10 | 11 | 12 | 13 | 14 | 15 |
| | | | | | Weekly Inspection | |
| 16 | 17 | 18 | 19 | 20 | 21 | 22 |
| | | | | | Weekly Inspection | |
| 23/30 | 24/31 | 25 | 26 | 27 | 28 | 29 |
| | Monthly Inventory Monthly Inspection | | | | Weekly Inspection | |

June 2021

Attach monthly inventory worksheet(s) or printout(s) here

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

Reminders - Permits, Insurance, Testing and Training

| | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

Monthly Gasoline Throughput Summary

| Product type | Amount delivered | Amount dispensed | Within variance? |
|----------------|------------------|------------------|------------------|
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

System Maintenance and Repair Record

| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
|-----------------|-------------------|---------------------------------|-------------|---|
| | | | | |
| | | | | |
| | | | | |
| | | | | |

Weekly Inspection Record

| Inspection date | Inspected by (initials) |
|-----------------|-------------------------|
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

June 2021

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday | | |
|--|--------|---------|---|-------------------------------------|-------------------|----------|-------------------|----|
| Need reminders of any deadlines this month? Mark this calendar! | | 1 | 2 | 3 | 4 | 5 | | |
| | | | | | | | Weekly Inspection | |
| | | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
| | | | | | | | Weekly Inspection | |
| | | 13 | 14 | 15 | 16 | 17 | 18 | 19 |
| | | | | | Weekly Inspection | | | |
| 20 | 21 | 22 | 23 | 24 | 25 | 26 | | |
| | | | | | Weekly Inspection | | | |
| 27 | 28 | 29 | 30 | Questions? Call 855-889-3021 | | | | |
| | | | Monthly Inventory Monthly Inspection | | | | | |

July 2021

Attach monthly inventory worksheet(s) or printout(s) here

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Reminders - Permits, Insurance, Testing and Training | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

July 2021

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|---|--------|---------|-----------|---|-----------------------------|---|
| Need reminders of any deadlines this month? Mark this calendar! Questions? Call 855-889-3021 | | | | 1 | 2 Weekly Inspection | 3 |
| 4 | 5 | 6 | 7 | 8 WPMCA Annual Convention | 9 Weekly Inspection | 10 |
| 11 | 12 | 13 | 14 | 15 | 16 Weekly Inspection | 17 |
| 18 | 19 | 20 | 21 | 22 | 23 Weekly Inspection | 24 |
| 25 | 26 | 27 | 28 | 29 | 30 Weekly Inspection | 31 Monthly Inventory Monthly Inspection |

Attach monthly inventory worksheet(s) or printout(s) here

August 2021

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Reminders - Permits, Insurance, Testing and Training | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

August 2021

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|--------|--------|---|---|----------|-------------------------|----------|
| 1 | 2 | 3 | 4 | 5 | 6 Weekly Inspection | 7 |
| 8 | 9 | 10 | 11 | 12 | 13 Weekly Inspection | 14 |
| 15 | 16 | 17 | 18 | 19 | 20 Weekly Inspection | 21 |
| 22 | 23 | 24 | 25 | 26 | 27 Weekly Inspection | 28 |
| 29 | 30 | 31 Monthly Inventory Monthly Inspection | Need reminders of any deadlines this month? Mark this calendar! Questions? Call 855-889-3021 | | | |

September 2021

Attach monthly inventory worksheet(s) or printout(s) here

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

Reminders - Permits, Insurance, Testing and Training

| | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

Monthly Gasoline Throughput Summary

| Product type | Amount delivered | Amount dispensed | Within variance? |
|----------------|------------------|------------------|------------------|
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

System Maintenance and Repair Record

| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
|-----------------|-------------------|---------------------------------|-------------|---|
| | | | | |
| | | | | |
| | | | | |
| | | | | |

Weekly Inspection Record

| Inspection date | Inspected by (initials) |
|-----------------|-------------------------|
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

September 2021

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|--|--------|---------|-----------|---|---|----------|
| Need reminders of any deadlines this month? Mark this calendar! | | | 1 | 2 | 3 Weekly Inspection | 4 |
| | | | 5 | 6 | 7 | 8 |
| 12 | 13 | 14 | 15 | 16 | 17 Weekly Inspection | 18 |
| 19 | 20 | 21 | 22 | 23 | 24 Weekly Inspection | 25 |
| 26 | 27 | 28 | 29 | 30 Monthly Inventory Monthly Inspection | Questions? Call 855-889-3021 | |

October 2021

Attach monthly inventory worksheet(s) or printout(s) here

Reminders - Permits, Insurance, Testing and Training

| | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

Monthly Gasoline Throughput Summary

| Product type | Amount delivered | Amount dispensed | Within variance? |
|----------------|------------------|------------------|------------------|
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |


| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

System Maintenance and Repair Record

| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
|-----------------|-------------------|---------------------------------|-------------|---|
| | | | | |
| | | | | |
| | | | | |
| | | | | |

Weekly Inspection Record

| Inspection date | Inspected by (initials) |
|-----------------|-------------------------|
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

October 2021

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|---|--------|---------|-----------|----------|-----------------------------|----------|
| Need reminders of any deadlines this month? Mark this calendar! Questions? Call 855-889-3021 | | | | | 1 Weekly Inspection | 2 |
| 3 | 4 | 5 | 6 | 7 | 8 Weekly Inspection | 9 |
| 10 | 11 | 12 | 13 | 14 | 15 Weekly Inspection | 16 |
| 17 | 18 | 19 | 20 | 21 | 22 Weekly Inspection | 23 |
| 24/31 Monthly Inventory Monthly Inspection | 25 | 26 | 27 | 28 | 29 Weekly Inspection | 30 |

Attach monthly inventory worksheet(s) or printout(s) here

November 2021

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Reminders - Permits, Insurance, Testing and Training | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

November 2021

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|--------|--------|---|---|----------|-------------------------|----------|
| | 1 | 2 | 3 | 4 | 5 Weekly Inspection | 6 |
| 7 | 8 | 9 | 10 | 11 | 12 Weekly Inspection | 13 |
| 14 | 15 | 16 | 17 | 18 | 19 Weekly Inspection | 20 |
| 21 | 22 | 23 | 24 | 25 | 26 Weekly Inspection | 27 |
| 28 | 29 | 30 Monthly Inventory Monthly Inspection | Need reminders of any deadlines this month? Mark this calendar! Questions? Call 855-889-3021 | | | |

Attach monthly inventory worksheet(s) or printout(s) here

December 2021

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Reminders - Permits, Insurance, Testing and Training | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

December 2021

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|--|--------|---------|-------------------|----------|--------|----------|
| <p style="text-align: center;">Need reminders of any deadlines this month? Mark this calendar! Questions? Call 855-889-3021</p> | | | 1 | 2 | 3 | 4 |
| | | | Weekly Inspection | | | |
| 5 | 6 | 7 | 8 | 9 | 10 | 11 |
| Weekly Inspection | | | | | | |
| 12 | 13 | 14 | 15 | 16 | 17 | 18 |
| Weekly Inspection | | | | | | |
| 19 | 20 | 21 | 22 | 23 | 24 | 25 |
| Weekly Inspection | | | | | | |
| 26 | 27 | 28 | 29 | 30 | 31 | |
| Monthly Inventory Monthly Inspection | | | | | | |

January 2022

Attach monthly inventory worksheet(s) or printout(s) here


| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Reminders - Permits, Insurance, Testing and Training | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

January 2022

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|--|---|---------|-----------|----------|-------------------|----------|
| <p>Need reminders of any deadlines this month? Mark this calendar!</p> <p>Questions? Call 855-889-3021</p> | | | | | | 1 |
| 2 | 3 | 4 | 5 | 6 | 7 | 8 |
| | | | | | Weekly Inspection | |
| 9 | 10 | 11 | 12 | 13 | 14 | 15 |
| | | | | | Weekly Inspection | |
| 16 | 17 | 18 | 19 | 20 | 21 | 22 |
| | | | | | Weekly Inspection | |
| 23/30 | 24/31 | 25 | 26 | 27 | 28 | 29 |
| | Monthly Inventory Monthly Inspection | | | | Weekly Inspection | |

Attach monthly inventory worksheet(s) or printout(s) here

February 2022

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Reminders - Permits, Insurance, Testing and Training | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

February 2022

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday | | |
|--|--------|---------|-----------|-------------------------------------|---------------------------------------|----------|--|----|
| Need reminders of any deadlines this month? Mark this calendar! | | 1 | 2 | 3 | 4 <small>Weekly Inspection</small> | 5 | | |
| | | 6 | 7 | 8 | 9 | 10 | 11 <small>Weekly Inspection</small> | 12 |
| | | 13 | 14 | 15 | 16 | 17 | 18 <small>Weekly Inspection</small> | 19 |
| | | 20 | 21 | 22 | 23 | 24 | 25 <small>Weekly Inspection</small> | 26 |
| | | 27 | 28 | Questions? Call 855-889-3021 | | | | |
| Monthly Inventory Monthly Inspection | | | | | | | | |

Attach monthly inventory worksheet(s) or printout(s) here

March 2022

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Reminders - Permits, Insurance, Testing and Training | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

March 2022

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday | | |
|--|--------|---------|-----------|---|-------------------------------------|----------|-------------------|----|
| Need reminders of any deadlines this month? Mark this calendar! | | 1 | 2 | 3 | 4 | 5 | | |
| | | | | | | | Weekly Inspection | |
| | | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
| | | | | | | | Weekly Inspection | |
| | | 13 | 14 | 15 | 16 | 17 | 18 | 19 |
| | | | | | Weekly Inspection | | | |
| 20 | 21 | 22 | 23 | 24 | 25 | 26 | | |
| | | | | | Weekly Inspection | | | |
| 27 | 28 | 29 | 30 | 31 | Questions? Call 855-889-3021 | | | |
| | | | | Monthly Inventory Monthly Inspection | | | | |

April 2022

Attach monthly inventory worksheet(s) or printout(s) here

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Reminders - Permits, Insurance, Testing and Training | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

April 2022

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|--|--------|---------|-----------|----------|-----------------------------|---|
| <p>Need reminders of any deadlines this month? Mark this calendar! Questions? Call 855-889-3021</p> | | | | | 1 Weekly Inspection | 2 |
| 3 | 4 | 5 | 6 | 7 | 8 Weekly Inspection | 9 |
| 10 | 11 | 12 | 13 | 14 | 15 Weekly Inspection | 16 |
| 17 | 18 | 19 | 20 | 21 | 22 Weekly Inspection | 23 |
| 24 | 25 | 26 | 27 | 28 | 29 Weekly Inspection | 30 Monthly Inventory Monthly Inspection |

Attach monthly inventory worksheet(s) or printout(s) here

May 2022

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Reminders - Permits, Insurance, Testing and Training | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

May 2022

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|--------|--------|---|--|----------|-----------------------------|----------|
| 1 | 2 | 3 | 4 | 5 | 6 Weekly Inspection | 7 |
| 8 | 9 | 10 | 11 | 12 | 13 Weekly Inspection | 14 |
| 15 | 16 | 17 | 18 | 19 | 20 Weekly Inspection | 21 |
| 22 | 23 | 24 | 25 | 26 | 27 Weekly Inspection | 28 |
| 29 | 30 | 31 Monthly Inventory Monthly Inspection | <p>Need reminders of any deadlines this month? Mark this calendar!</p> <p>Questions? Call 855-889-3021</p> | | | |

June 2022

Attach monthly inventory worksheet(s) or printout(s) here

Reminders - Permits, Insurance, Testing and Training

| | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

Monthly Gasoline Throughput Summary

| Product type | Amount delivered | Amount dispensed | Within variance? |
|----------------|------------------|------------------|------------------|
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

Monthly Inspection, Condensed Record

(perform by end of each month or 30 days apart; see page 56 for expanded checklist)

| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
|--|------------|-----------|-------------------------------|--------------------------|
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

System Maintenance and Repair Record

| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
|-----------------|-------------------|---------------------------------|-------------|---|
| | | | | |
| | | | | |
| | | | | |
| | | | | |

Weekly Inspection Record

| Inspection date | Inspected by (initials) |
|-----------------|-------------------------|
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

June 2022

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|--|--------|---------|-----------|---|---|----------|
| Need reminders of any deadlines this month? Mark this calendar! | | | 1 | 2 | 3 Weekly Inspection | 4 |
| | | | 5 | 6 | 7 | 8 |
| 12 | 13 | 14 | 15 | 16 | 17 Weekly Inspection | 18 |
| 19 | 20 | 21 | 22 | 23 | 24 Weekly Inspection | 25 |
| 26 | 27 | 28 | 29 | 30 Monthly Inventory Monthly Inspection | Questions? Call 855-889-3021 | |

July 2022

Attach monthly inventory worksheet(s) or printout(s) here

Reminders - Permits, Insurance, Testing and Training

| | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

Monthly Gasoline Throughput Summary

| Product type | Amount delivered | Amount dispensed | Within variance? |
|----------------|------------------|------------------|------------------|
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

System Maintenance and Repair Record

| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
|-----------------|-------------------|---------------------------------|-------------|---|
| | | | | |
| | | | | |
| | | | | |
| | | | | |

Weekly Inspection Record

| Inspection date | Inspected by (initials) |
|-----------------|-------------------------|
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

July 2022

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|--|--------|---------|-----------|----------|-------------------|----------|
| <p>Need reminders of any deadlines this month? Mark this calendar!</p> <p>Questions? Call 855-889-3021</p> | | | | | 1 | 2 |
| 3 | 4 | 5 | 6 | 7 | 8 | 9 |
| | | | | | Weekly Inspection | |
| 10 | 11 | 12 | 13 | 14 | 15 | 16 |
| | | | | | Weekly Inspection | |
| 17 | 18 | 19 | 20 | 21 | 22 | 23 |
| | | | | | Weekly Inspection | |
| 24/31 | 25 | 26 | 27 | 28 | 29 | 30 |
| Monthly Inventory Monthly Inspection | | | | | Weekly Inspection | |

August 2022

Attach monthly inventory worksheet(s) or printout(s) here

Reminders - Permits, Insurance, Testing and Training

| | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

Monthly Gasoline Throughput Summary

| Product type | Amount delivered | Amount dispensed | Within variance? |
|----------------|------------------|------------------|------------------|
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

System Maintenance and Repair Record

| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
|-----------------|-------------------|---------------------------------|-------------|---|
| | | | | |
| | | | | |
| | | | | |
| | | | | |

Weekly Inspection Record

| Inspection date | Inspected by (initials) |
|-----------------|-------------------------|
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

August 2022

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|--------|--------|---------|---|--|-----------------------------|----------|
| | 1 | 2 | 3 | 4 | 5 Weekly Inspection | 6 |
| 7 | 8 | 9 | 10 | 11 | 12 Weekly Inspection | 13 |
| 14 | 15 | 16 | 17 | 18 | 19 Weekly Inspection | 20 |
| 21 | 22 | 23 | 24 | 25 | 26 Weekly Inspection | 27 |
| 28 | 29 | 30 | 31 Monthly Inventory Monthly Inspection | <p>Need reminders of any deadlines this month? Mark this calendar!</p> <p>Questions? Call 855-889-3021</p> | | |

September 2022

Attach monthly inventory worksheet(s) or printout(s) here

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

Reminders - Permits, Insurance, Testing and Training

| | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

Monthly Gasoline Throughput Summary

| Product type | Amount delivered | Amount dispensed | Within variance? |
|----------------|------------------|------------------|------------------|
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

System Maintenance and Repair Record

| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
|-----------------|-------------------|---------------------------------|-------------|---|
| | | | | |
| | | | | |
| | | | | |
| | | | | |

Weekly Inspection Record

| Inspection date | Inspected by (initials) |
|-----------------|-------------------------|
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

September 2022

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|---|--------|---------|-----------|----------|---|----------|
| Need reminders of any deadlines this month? Mark this calendar! Questions? Call 855-889-3021 | | | | 1 | 2 | 3 |
| 4 | 5 | 6 | 7 | 8 | 9 | 10 |
| 11 | 12 | 13 | 14 | 15 | 16 | 17 |
| 18 | 19 | 20 | 21 | 22 | 23 | 24 |
| 25 | 26 | 27 | 28 | 29 | 30 | |
| | | | | | Weekly Inspection | |
| | | | | | Weekly Inspection | |
| | | | | | Weekly Inspection | |
| | | | | | Weekly Inspection | |
| | | | | | Monthly Inventory Monthly Inspection | |

October 2022

Attach monthly inventory worksheet(s) or printout(s) here

Reminders - Permits, Insurance, Testing and Training

| | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

Monthly Gasoline Throughput Summary

| Product type | Amount delivered | Amount dispensed | Within variance? |
|----------------|------------------|------------------|------------------|
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

System Maintenance and Repair Record

| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
|-----------------|-------------------|---------------------------------|-------------|---|
| | | | | |
| | | | | |
| | | | | |
| | | | | |

Weekly Inspection Record

| Inspection date | Inspected by (initials) |
|-----------------|-------------------------|
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

October 2022

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|--|---|---------|-----------|----------|-------------------|----------|
| <p>Need reminders of any deadlines this month? Mark this calendar!</p> <p>Questions? Call 855-889-3021</p> | | | | | | 1 |
| 2 | 3 | 4 | 5 | 6 | 7 | 8 |
| | | | | | Weekly Inspection | |
| 9 | 10 | 11 | 12 | 13 | 14 | 15 |
| | | | | | Weekly Inspection | |
| 16 | 17 | 18 | 19 | 20 | 21 | 22 |
| | | | | | Weekly Inspection | |
| 23/30 | 24/31 | 25 | 26 | 27 | 28 | 29 |
| | Monthly Inventory Monthly Inspection | | | | Weekly Inspection | |

Attach monthly inventory worksheet(s) or printout(s) here

November 2022

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Reminders - Permits, Insurance, Testing and Training | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

November 2022

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|--|--------|---------|---|-------------------------------------|-----------------------------|----------|
| Need reminders of any deadlines this month? Mark this calendar! | | 1 | 2 | 3 | 4 Weekly Inspection | 5 |
| | | 6 | 7 | 8 | 9 | 10 |
| 13 | 14 | 15 | 16 | 17 | 18 Weekly Inspection | 19 |
| 20 | 21 | 22 | 23 | 24 | 25 Weekly Inspection | 26 |
| 27 | 28 | 29 | 30 Monthly Inventory Monthly Inspection | Questions? Call 855-889-3021 | | |

Attach monthly inventory worksheet(s) or printout(s) here

December 2022

| Monthly Inspection, Condensed Record (perform by end of each month or 30 days apart; see page 56 for expanded checklist) | | | | |
|--|------------|-----------|-------------------------------|--------------------------|
| Inspection area | Inspected? | Repaired? | Logged on maintenance record? | Inspected by? (initials) |
| Underground storage tanks and gasoline dispensing equipment (includes Stage I vapor control system for facilities in Stage I areas) | | | | |
| Release detection system (tank monitor) | | | | |
| Spill buckets | | | | |
| Overfill alarm | | | | |
| Impressed current system (if applicable) | | | | |
| Fill and monitoring probe ports | | | | |
| Spill and overfill response supplies | | | | |
| Dispenser hoses, nozzles and breakaways | | | | |
| Dispenser and dispenser sumps | | | | |
| Piping sumps (submersible) | | | | |
| Stage II vapor recovery systems for gasoline dispensing facilities retaining these systems (inspecting the equipment below is optional but recommended - see page 66) | | | | |
| Vapor return line | | | | |
| Nozzle bellows | | | | |
| Nozzle faceplate / facecones | | | | |
| Nozzles | | | | |
| Vapor processing unit working properly | | | | |

| Reminders - Permits, Insurance, Testing and Training | |
|---|----------|
| Are tank permits up to date? | Yes / No |
| Is tank insurance due this month? | Yes / No |
| Is equipment testing due this month? Are most recent test results on site? | Yes / No |
| Is all training up to date for current employees? | Yes / No |

| Monthly Gasoline Throughput Summary | | | |
|-------------------------------------|------------------|------------------|------------------|
| Product type | Amount delivered | Amount dispensed | Within variance? |
| | + | + | Yes / No |
| | + | + | Yes / No |
| | + | + | Yes / No |
| Monthly totals | = | = | |

| System Maintenance and Repair Record | | | | |
|--------------------------------------|-------------------|---------------------------------|-------------|---|
| Inspection date | Name of inspector | Identify problem/defective part | Repair date | Replacement part manufacturer/part number |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| Weekly Inspection Record | |
|--------------------------|-------------------------|
| Inspection date | Inspected by (initials) |
| | |
| | |
| | |
| | |



Compliance Calendar for Gasoline Dispensing Facilities

December 2022

| Sunday | Monday | Tuesday | Wednesday | Thursday | Friday | Saturday |
|---|--------|---------|-----------|----------|-----------------------------|---|
| Need reminders of any deadlines this month? Mark this calendar! Questions? Call 855-889-3021 | | | | 1 | 2 Weekly Inspection | 3 |
| 4 | 5 | 6 | 7 | 8 | 9 Weekly Inspection | 10 |
| 11 | 12 | 13 | 14 | 15 | 16 Weekly Inspection | 17 |
| 18 | 19 | 20 | 21 | 22 | 23 Weekly Inspection | 24 |
| 25 | 26 | 27 | 28 | 29 | 30 Weekly Inspection | 31 Monthly Inventory Monthly Inspection |

Monthly Walkthrough & Inspection Checklist

For Underground Storage Tanks & Motor Fuel Dispensing Equipment

At least monthly, conduct basic walkthrough inspections of the facility to make sure that all essential equipment is working properly and that there are fuel release response supplies on hand. Perform the monthly inspection on the last working day of the month.

To document walkthroughs, record the date of each monthly inspection under the month name. For each device/system inspected, mark whether it was working properly (for example, “ok”) or was defective and needed repair (for example, “not ok” or “needs repair”). Initial all entries. Make sure to keep records of all repairs and record the dates and parts repaired/replaced on the maintenance log.

The first section of this monthly checklist addresses the basic inspection areas applicable to all gas stations. The second section addresses inspection areas for facilities that choose to retain Stage II vapor recovery systems (monthly inspections of Stage II equipment are not required but recommended - see **page 66**).

Effective November 1, 2019, monthly walkthrough inspections are required to be either performed or reviewed by the class B operator for the facility.

| Inspection point | Jan | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec |
|---|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Inspection date | | | | | | | | | | | | |
| Inspected by | | | | | | | | | | | | |
| Underground storage tanks and motor fuel dispensing equipment | | | | | | | | | | | | |
| Release detection system Inspect for proper operation. Run quick “self-test” of automatic tank gauging (ATG) to verify correct operation, or check manual dip stick for wear or warping. | | | | | | | | | | | | |
| Spill buckets Ensure spill buckets are clean, empty and free of debris. | | | | | | | | | | | | |
| Overfill alarm Inspect for proper operation. Make sure alarm is easily seen and heard. | | | | | | | | | | | | |
| Impressed current cathodic protection system Inspect for proper operation. Check and log rectifier at least every 60 days. | | | | | | | | | | | | |
| Fill and monitoring ports Inspect to make sure covers and caps are tightly sealed and locked. | | | | | | | | | | | | |
| Spill and overfill response supplies Inventory emergency spill response supplies and restock if low. Inspect supplies for deterioration and improper functioning. | | | | | | | | | | | | |

Monthly Walkthrough & Inspection Checklist (continued)

| | | | | | | | | | | | | | |
|---|--|--|--|--|--|--|--|--|--|--|--|--|--|
| <p>Dispenser hoses, nozzles, breakaways Inspect for loose fittings, deterioration, obvious signs of leakage or improper functioning. Verify that hose retriever is in good condition.</p> | | | | | | | | | | | | | |
| <p>Dispensers/dispenser sumps (internal) Open dispensers; inspect visible piping, fittings, couplings for leaks. Dispose any water, product. Ensure filter clean, dry, dated. Meter clean, dry, sealed. Union clean, dry. Emergency shutoff valve clean, dry; trip arm not obstructed. Suction pump and air eliminator clean, dry; air eliminator vent not obstructed; v-belt in good condition. Dispenser cabinet intact; no jagged edges. Remove debris from sump.</p> | | | | | | | | | | | | | |
| <p>Dispensers (external) Warnings and fueling instructions posted on dispenser and readable. Emergency stop (e-stop) easy to see and accessible. Verify station has spill cleanup and dispenser out-of-service supplies on hand.</p> | | | | | | | | | | | | | |
| <p>Piping sumps Inspect visible piping, fittings and couplings for leakage. Remove and dispose of water or product. Remove debris from sump.</p> | | | | | | | | | | | | | |
| <p>Signature of B operator who conducted or reviewed the monthly walkthrough inspection.</p> | | | | | | | | | | | | | |
| <p>Gasoline dispensing equipment at facilities that choose to retain Stage II vapor recovery systems (optional but recommended - see page 66)</p> | | | | | | | | | | | | | |
| <p>Vapor return line not crimped, flattened, blocked; no holes, slits. Poppets work properly, seal tightly. Inspect breakaways, swivels.</p> | | | | | | | | | | | | | |
| <p>Nozzle bellows Ensure there are no holes larger than 0.25" or slits larger than 1".</p> | | | | | | | | | | | | | |
| <p>Nozzle faceplate or facecone Ensure it's not torn or missing more than 25% of its surface.</p> | | | | | | | | | | | | | |
| <p>Nozzle Make sure it's operating properly and has an automatic overfill control mechanism.</p> | | | | | | | | | | | | | |
| <p>Vapor processing unit Check for defects including leaking return line, intermittent process interruptions, low vapor pressure in return to tank line or inoperable Stage I control, e.g. pressure vacuum vent.</p> | | | | | | | | | | | | | |

Weekly Inspection Checklist

| Inspection point | Inspected? | Repaired? | Repair logged on maintenance record? |
|--|------------|-----------|--------------------------------------|
| Underground storage tanks and loading equipment—Stage I vapor recovery | | | |
| Spill containment buckets <ul style="list-style-type: none"> • clean and dry; no liquid in bottom; no solid debris; vapor tight • remove liquid if present | Y N | Y N | Y N |
| Caps and gaskets <ul style="list-style-type: none"> • locking caps on fill and vapor tubes locked in place; gasket in place and secure | Y N | Y N | Y N |
| Fill tubes <ul style="list-style-type: none"> • not damaged, bent or loose; underground storage tank (UST) fittings on product fill tubes and vapor tubes secure, in place, without damage or leaks | Y N | Y N | Y N |
| Pressure vacuum valves <ul style="list-style-type: none"> • vent installed and not damaged; no vapor escape from vent tubes (visual inspection); pipes not bent, damaged or obstructed by any objects | Y N | Y N | Y N |
| Poppets <ul style="list-style-type: none"> • not broken; check for tight seals | Y N | Y N | Y N |
| Gasoline dispensing equipment—Stage II vapor recovery (inspecting the equipment below is not required but recommended for facilities that choose to retain Stage II systems - see page 66) | | | |
| Pumps <ul style="list-style-type: none"> • no signs of vapor or liquid leaks • approved operating and warning labels are present and visible | Y N | Y N | Y N |
| Nozzles <ul style="list-style-type: none"> • spouts not bent, worn, dented, loose or leaking; latch and trigger working properly • vapor recovery holes clear and unblocked (if applicable) • auto shutoffs working properly | Y N | Y N | Y N |
| Vapor guards, boots, facecones, faceplates and bellows (if applicable) <ul style="list-style-type: none"> • no rips or tears; not loose from nozzle; faceplate not torn | Y N | Y N | Y N |
| Hoses <ul style="list-style-type: none"> • proper length; no kinks, flat spots, tears or cuts | Y N | Y N | Y N |
| Breakaways <ul style="list-style-type: none"> • secure and tight; no sign of leaks | Y N | Y N | Y N |
| Swivels <ul style="list-style-type: none"> • firmly attached; move freely; no sign of leaks | Y N | Y N | Y N |
| Poppets (impact valve, vapor line) <ul style="list-style-type: none"> • not broken; check for tight seals | Y N | Y N | Y N |
| Signs on dispensers <ul style="list-style-type: none"> • “Do Not Top Off” clearly posted on dispensers | Y N | Y N | Y N |
| Healy or Hasstech monitor (if applicable) <ul style="list-style-type: none"> • check for failure or error codes | Y N | Y N | Y N |

Training Logs

ATCP 93—The “Operator Designations and Training Log” can help facilities meet their record keeping requirements. Use it to record the Class A, B and C operators at the facility and keep track of their training and required documentation.

NR 420—If a facility chooses to retain a Stage II vapor recovery system, employee training is not required but recommended (see **page 66** for more information). Use the Stage II log below to document training at the facility.

Keep these logs up to date, and they can serve as part of the facility’s official record!

Operator Designations & Training Log (ATCP 93)

| Name of employee | Class of operator | Training date | Training provider | Documentation on file? |
|------------------|-------------------|---------------|-------------------|------------------------|
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

Employee Training at Facilities That Choose to Retain Stage II Vapor Recovery Systems (training is not required but recommended - see page 66)

| Name of employee | Dates of training | Areas/subjects of training | Amount of training |
|------------------|-------------------|----------------------------|--------------------|
| | | | |
| | | | |
| | | | |
| | | | |

Gasoline Inventory Tracking & Verification Worksheet

| Month & year | | | | | | Facility | | | |
|---|----------------------------|------------------|-------------|----------------------|-------------------|--------------------|----------------------------|-------------------------|----------|
| Type of product | | | | | | Address | | | |
| Tank capacity | | | | | | Tank number | | | |
| date | opening inventory (in/gal) | amount delivered | amount sold | calculated inventory | closing inventory | daily variance (±) | cumulative variance (±) | water depth (to 1/8 in) | initials |
| 1 | | | | | | | | | |
| 2 | | | | | | | | | |
| 3 | | | | | | | | | |
| 4 | | | | | | | | | |
| 5 | | | | | | | | | |
| 6 | | | | | | | | | |
| 7 | | | | | | | | | |
| 8 | | | | | | | | | |
| 9 | | | | | | | | | |
| 10 | | | | | | | | | |
| 11 | | | | | | | | | |
| 12 | | | | | | | | | |
| 13 | | | | | | | | | |
| 14 | | | | | | | | | |
| 15 | | | | | | | | | |
| 16 | | | | | | | | | |
| 17 | | | | | | | | | |
| 18 | | | | | | | | | |
| 19 | | | | | | | | | |
| 20 | | | | | | | | | |
| 21 | | | | | | | | | |
| 22 | | | | | | | | | |
| 23 | | | | | | | | | |
| 24 | | | | | | | | | |
| 25 | | | | | | | | | |
| 26 | | | | | | | | | |
| 27 | | | | | | | | | |
| 28 | | | | | | | | | |
| 29 | | | | | | | | | |
| 30 | | | | | | | | | |
| 31 | | | | | | | | | |
| Totals | | | | | | | | | |
| If using inventory control, allowable variance--> | | | | | | | Meets requirements? | | Y N |

Using the worksheet

(Copy as needed)
 To use this worksheet, record gasoline amounts in gallons every day for opening inventory, amount delivered into the tank, amount sold and closing inventory. When checking for water in the tank, record water depth to 1/8 inch. Initial entries for each day.

To keep track of monthly throughput and perform inventory verification, do these calculations as follows and record the amounts on the worksheet:

- Monthly total gasoline delivered or sold for this tank = sum of gasoline delivered or sold on all days during the month
- Monthly gasoline throughput = total gasoline delivered or sold during the month
- Calculated inventory = opening inventory + amount delivered - amount sold
- Daily variance = closing inventory - calculated inventory
- Monthly total variance = sum of daily variances for all days of the month
- Cumulative variance = yesterday's cumulative variance + today's daily variance
- For inventory control, allowable variance = 0.005 x monthly total gasoline sold

Inventory verification—reconcile measurements every month to determine whether:

- a leak detection method has failed
- unauthorized product mixing has occurred
- theft of product has occurred

Throughput - 12 Month Rolling Totals

| Month | Throughput (gals) | Last month's rolling total | Throughput from this month last year | New 12 month rolling total |
|----------------|-------------------|----------------------------|--------------------------------------|----------------------------|
| January 2021 | | + | - | = |
| February 2021 | | + | - | = |
| March 2021 | | + | - | = |
| April 2021 | | + | - | = |
| May 2021 | | + | - | = |
| June 2021 | | + | - | = |
| July 2021 | | + | - | = |
| August 2021 | | + | - | = |
| Septmber 2021 | | + | - | = |
| October 2021 | | + | - | = |
| November 2021 | | + | - | = |
| December 2021 | | + | - | = |
| January 2022 | | + | - | = |
| February 2022 | | + | - | = |
| March 2022 | | + | - | = |
| April 2022 | | + | - | = |
| May 2022 | | + | - | = |
| June 2022 | | + | - | = |
| July 2022 | | + | - | = |
| August 2022 | | + | - | = |
| September 2022 | | + | - | = |
| October 2022 | | + | - | = |
| November 2022 | | + | - | = |
| December 2022 | | + | - | = |

Use this table to track 12 month rolling totals for throughput. To calculate, add up the throughput for the last 12 months. Each month, add the month's throughput to last month's rolling total and subtract throughput from that month last year. Use this table to demonstrate compliance with NR 445. See **page 69** for details.

Introduction to Vapor Recovery

Both the federal and state regulations for gasoline dispensing facilities refer to “vapor control” or “vapor recovery” as a means of reducing pollutant emissions.

What is a vapor recovery system, and how does it capture gasoline vapors?

Certified vapor recovery systems include hoses, nozzles, processors and other equipment that create a closed system which returns gasoline vapor back to the underground storage tank and then back to the truck that delivers gasoline to a station. The system and equipment are designed to capture vapor before it is released to the air. There are two phases of gasoline vapor recovery, sometimes called Stage I and Stage II.

Stage I vapor recovery—underground storage tanks and loading equipment

Stage I vapor recovery is a control method for capturing gasoline vapors that are released when gasoline is delivered to a storage tank. Instead of being released to the air, the vapors are returned to the tank truck as the storage tank is filled. From there, vapors can be transported back to the terminal vapor processor for recovery or destruction.

Per state regulations, Stage I vapor recovery requirements apply to gasoline dispensing facilities located in 20 Wisconsin counties (see the NR 420 factsheet on [page 66](#)).

However, due to federal regulations, some facilities in other parts of Wisconsin are also



required to have vapor control systems on their storage tanks. The National Emissions Standards for Hazardous Air Pollutants (NESHAP) require **vapor balancing**, which consists of controls similar to Wisconsin’s Stage I vapor recovery requirements, at all facilities with gasoline throughput of 100,000 gallons per month or more (see the NESHAP factsheet on the following page).

Stage II vapor recovery—gasoline dispensing equipment

Stage II vapor recovery captures gasoline vapor that would otherwise escape into the air when motorists refuel their vehicles. Special dispensing nozzles fitted with vapor return lines send vapors back to the storage tank through the pump hose.

Stage II vapor recovery systems had been required at gas stations in southeastern Wisconsin for many years. However, in May 2012, a finding by the U.S. Environmental Protection Agency determined that onboard refueling vapor recovery technology is now widespread in motor vehicles, and the technology performs the same function as a Stage II system. This finding allows states, including Wisconsin, to no longer require Stage II vapor recovery. Gas stations operating Stage II systems have the option of formally decommissioning the systems (see the NR 420 factsheet on [page 67](#)).

The following factsheets contain information about each of the three rules relevant to gasoline dispensing facilities: the federal NESHAP, Wisconsin vapor recovery requirements and Wisconsin storage tank regulations.

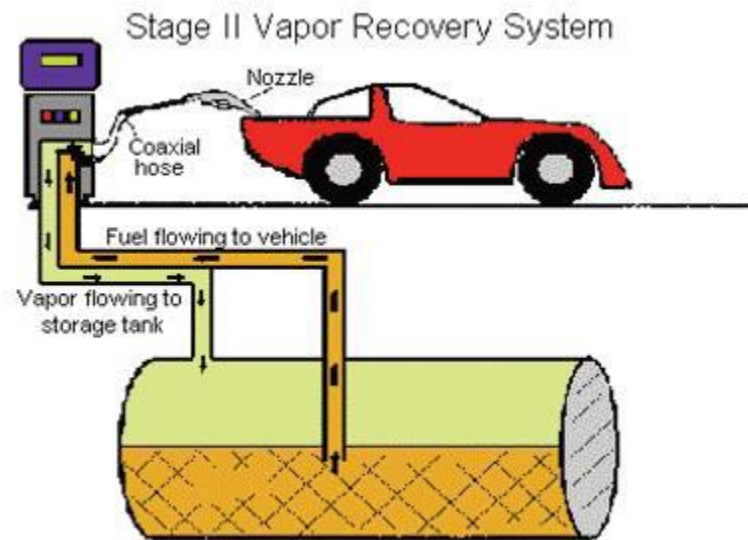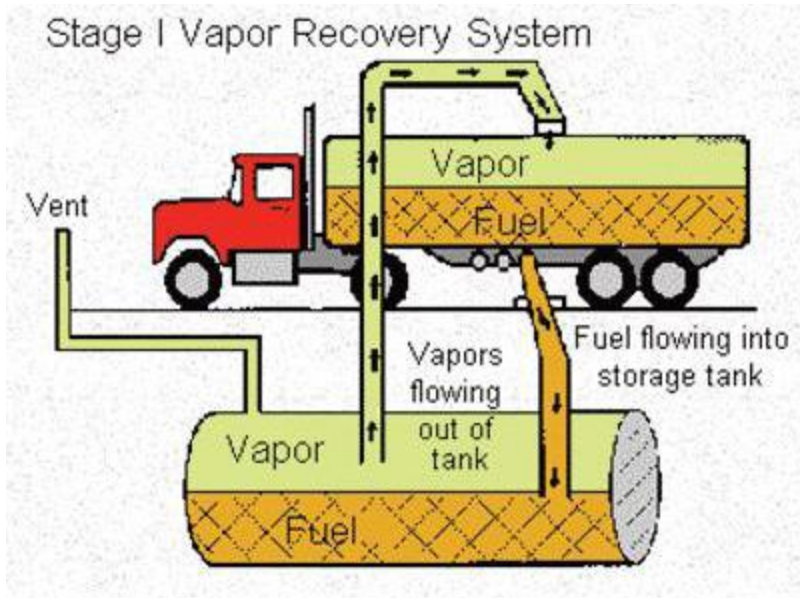

National Emission Standards for Hazardous Air Pollutants from Gasoline Dispensing Facilities (NESHAP) (40 CFR part 63, subpart CCCCC)

This U.S. Environmental Protection Agency (U.S. EPA) rule regulates vapor control during the filling of gasoline storage tanks at gas stations and other gasoline dispensing facilities. The agency published the NESHAP for gasoline dispensing facilities on January 10, 2008 and subsequently amended the rule on January 24, 2011.

U.S. EPA estimated that implementing the rule would reduce emissions of volatile organic compounds (VOCs) by 100,000 tons per year and emissions of hazardous air pollutants (HAPs) by 5,000 tons per year. This includes a reduction of 175 tons of benzene, one of the more toxic compounds in gasoline vapor.

Who is affected?

The rule affects “area sources,” which include all gasoline dispensing facilities that emit less than 10 tons per year of a single hazardous air pollutant (HAP) or less than 25 tons per year of any combination of HAPs. Most gas stations fall into this group.

The rule applies to all stationary facilities that dispense gasoline into the fuel tanks of motor vehicles, boats, lawn and landscaping equipment, generators and other gasoline-fueled engines. The rule specifically applies to gasoline dispensing, and the U.S. EPA’s definition of gasoline does **not** include diesel fuel. See the Definitions section on **page 80** for more information about gasoline and gasoline dispensing facilities.

When are the compliance deadlines?

Compliance deadlines for existing facilities have passed. New or reconstructed facilities should comply upon startup.

Existing facilities that become subject to control requirements because their gasoline throughput increases must comply within three years.

What are the required controls and management practices?

The type of vapor control required depends on the monthly gasoline throughput of the facility. U.S. EPA has a specific definition of “throughput” and how to calculate it. See the Definitions section of this calendar for more information (check the entry under “monthly throughput” on **page 80**).

The table on the next page summarizes the specific requirements for gas stations at each throughput level.

What compliance testing and monitoring is required?

The testing requirement applies to facilities with throughput of 100,000 gallons of gasoline per month or more—that is, the facilities required to use vapor control systems. See the table on the next page for specific information about the testing requirement. The rule specifies the approved testing methods that can be used to meet this requirement (section 63.11120).

What are the record keeping and notification requirements?

Record keeping and notification required by this rule depend on the amount of gasoline dispensed at the facility. Refer to the table on the next page for the specific requirements.

All records required by this rule must be kept at the facility for five years. This includes records for monthly gasoline throughput. **Use this calendar and save it to help meet the record keeping obligations!**

For more information, contact:

Charles Hall at U.S. EPA’s Region 5 office in Chicago is the contact for the federal NESHAP for gasoline facilities in Wisconsin. He can be reached at 312-353-3443 or hall.charles@epa.gov.

Additional information is available at <http://dnr.wi.gov/>. Search “gas stations” and refer to the Federal hazardous air pollution rules section of the gas station web page.

Where should notifications & test results be sent?

All required notifications should be sent to U.S. EPA’s Region 5 office:

U.S. EPA Region 5
Compliance Trackers AE-17J
77 West Jackson Blvd.
Chicago, IL 60604-3507

A copy of each notification should be sent to DNR:

MACT Notifications
WDNR Air Program AM/7
PO Box 7921
Madison, WI 53707-7921

Summary of U.S. EPA’s Emission Standard for HAPs at Gasoline Dispensing Facilities (40 CFR part 63, subpart CCCCCC)

| If throughput is... | Required actions | Required record keeping and/or reporting |
|--|--|--|
| less than 10,000 gallons per month | Use the following good management practices to handle gasoline in a manner that avoids vapor releases to the atmosphere for extended periods of time: <ol style="list-style-type: none"> 1. Minimize spills 2. Clean up spills expeditiously 3. Cover gasoline containers and storage tank fill pipes with gasketed seals 4. Minimize gasoline sent to open waste collection systems | Track monthly gasoline throughput. Demonstrate that gasoline throughput is less than 10,000 gallons per month within 24 hours of request by U.S. EPA or Wisconsin DNR. Facilities are not required to submit any notifications to U.S. EPA or DNR. |
| 10,000 gallons per month or more, if tanks are less than 250 gallons capacity | Only requirements 1-4 above apply. | Requirements above apply. |
| 10,000 gallons per month or more, if tanks are at least 250 gallons capacity | Requirements 1-4 above apply, plus: <ol style="list-style-type: none"> 5. Load gasoline into storage tanks using submerged filling. Discharge must be no more than the following distances from bottom of tank: <ol style="list-style-type: none"> a) 12 inches for pipes installed on or before November 9, 2006 b) 6 inches for pipes installed after November 9, 2006 | <ol style="list-style-type: none"> 1. New or reconstructed facilities: submit “Initial Notification” indicating that they are subject to the requirements of the rule within 15 days. Existing facilities: the deadline for submitting the initial notification has passed. 2. Submit “Notification of Compliance Status” certifying that the facility has complied with the rule requirements by the applicable date (see “When are compliance deadlines” on page 63). Sample compliance notification forms are available at http://dnr.wi.gov/ (search “gas stations” and refer to the Federal hazardous air pollution rules section of the gas station web page). See the text box on page 63 for information about where to send notifications. |
| 100,000 gallons per month or more, if tanks are: <ul style="list-style-type: none"> • less than 250 gallons capacity, if constructed after Jan 10, 2008 • less than 2,000 gallons capacity, if constructed before Jan 10, 2008 • equipped with floating roofs | Requirements 1-5 above apply. | Requirements 1-2 above apply. |

Summary of U.S. EPA's Emission Standard for HAPs at Gasoline Dispensing Facilities (continued)

| If throughput is... | Required actions | Required record keeping and/or reporting |
|-----------------------------------|--|---|
| 100,000 gallons per month or more | Requirements 1-5 above apply. In addition, new and reconstructed gasoline dispensing facilities must install a vapor balance system upon startup. (Vapor balance systems collect vapors released when a storage tank is loaded and route them back into the tank truck.) The vapor balance system must meet one of the requirements below (6 or 7): | |
| | <p>6. Operate a vapor balance system on storage tanks that meets the following management practices:</p> <ul style="list-style-type: none"> a) equip connections and lines with closures that seal when disconnected b) vapor-tight line from storage tank to cargo tank c) cargo tank pressure remains below specified settings d) adaptors and connectors designed to prevent over-tight/loose fittings during delivery e) if gauge well used, gauge well provided with submerged drop tube extending specified distance from tank bottom (see item 5 above) f) use vapor-tight caps for liquid fill connections g) install pressure/vacuum vent valves on tank vent pipes to meet specified requirements, and test initially and every three years h) vapor balance system must meet specified static pressure; performance test conducted initially and every three years i) for new or reconstructed facilities or new tanks installed at existing facilities, use dual-point (no coaxial) vapor balance systems | <p>Requirements 1-2 above apply, plus:</p> <p>3. Keep records of pressure tests. The tests are required at the time of installation and every three years thereafter to determine the leak rate and cracking pressure of pressure/vacuum vent valves installed on gasoline storage tanks. Some owners or operators, depending on which vapor balance option is used, must also conduct a static pressure test on gasoline storage tanks. Notification of performance testing is due 60 days before testing, and test results are due 180 days after testing.</p> <p>See the text box on page 63 for information about where to send notifications and test results.</p> |
| | 7. Operate a vapor balance system demonstrated to achieve a reduction of 95 percent or better. | <p>Requirements 1-3 above apply, plus:</p> <p>4. Conduct initial performance test to demonstrate that vapor balance system achieves 95 percent reduction. Test notification is due 60 days before testing, and test results are due 180 days after testing.</p> <p>See the text box on page 63 for information about where to send notifications and test results.</p> |

Wisconsin's Regulation for Control of Organic Compound Emissions from Petroleum and Gasoline Sources (ch. NR 420, *Wis. Adm. Code*)

The federal Clean Air Act requires states to minimize and control air pollution. Measures to control air emissions are specifically required in areas that have not met federal ambient air quality standards, and Wisconsin contains some of these areas. The Wisconsin Department of Natural Resources (DNR) administers Chapter NR 420 of the Wisconsin Administrative Code to control vapors that can be released during the filling of gasoline storage tanks, and formerly, to control vapors that can be released during motor vehicle refueling. The volatile organic compounds in these vapors contribute to ground level ozone. Ch. NR 420 applies to gasoline dispensing facilities and delivery vessels used to bring gasoline to these facilities.

Ch. NR 420 regulates the control of gasoline vapors through Stage I vapor recovery requirements. For more information about Stage I systems, see [page 62](#).

Who is affected by this rule?

Stage I vapor recovery requirements affect gasoline dispensing facilities located in these 20 Wisconsin counties:

- Brown
- Calumet
- Dane
- Dodge
- Door
- Fond du Lac
- Jefferson
- Kenosha
- Kewaunee
- Manitowoc
- Milwaukee
- Outagamie
- Ozaukee
- Racine
- Rock
- Sheboygan
- Walworth
- Washington
- Waukesha
- Winnebago

The Stage I requirements apply to facilities in the above counties that have storage tanks with a capacity of:

- more than 2,000 gallons if installed on or before August 1, 1979
- more than 575 gallons if installed after August 1, 1979

Previous Stage II vapor recovery requirements applied to gasoline dispensing facilities located in these nine Wisconsin counties:

- Kenosha
- Kewaunee
- Manitowoc
- Milwaukee
- Ozaukee
- Racine
- Sheboygan
- Washington
- Waukesha

However, these facilities now have the option of decommissioning their Stage II systems.

The sections below provide brief summaries of the Stage I requirements and the Stage II decommissioning option.

What are the rule's requirements for filling gasoline storage tanks (Stage I)?

The Stage I vapor recovery requirements are contained in s. NR 420.04(3), *Wis. Adm. Code*. For gasoline dispensing facilities in the 20 counties subject to the Stage I requirements, gasoline must be transferred from delivery vessels into storage tanks using:

- a submerged fill pipe on the storage tank
- a vapor control system

Vapor Control System—The vapor control system should include at least one of the following:

- a vapor balance system with a vapor-tight vapor return line from storage tank to delivery vessel
- a refrigeration-condensation system capable of recovering at least 90 percent by weight of organic compounds in the displaced vapor or an equally effective alternative control method approved by DNR

Vapor Control Equipment Installation and Maintenance—All control equipment must be installed to meet the requirements in s. NR 420.04(3)(g), *Wis. Adm. Code*. Worn out or malfunctioning equipment must be repaired, replaced or modified. Keep records of all repairs.

Wisconsin's Regulation for Control of Organic Compound Emissions from Petroleum and Gasoline Sources (continued)

Operation and Maintenance Instructions—The facility owner must provide written instructions to the facility operator describing necessary operating and maintenance procedures and procedures for prompt notification of the owner in case of any malfunction of the control system.

Please refer to the official rule language for complete requirements.

Are Stage II vapor recovery systems still required?

No, the Stage II requirements formerly contained in s. NR 420.045, *Wis. Adm. Code* have been repealed. While DNR no longer regulates Stage II systems, DATCP expects that facilities follow proper decommissioning procedures if they do decide to remove or decommission their systems.

DATCP Stage II Decommissioning Procedure—The appropriate procedure for decommissioning can be found in PEI Manual 300-09, Section 14. Facilities should submit **a formal notification, completed decommissioning checklist and test report** to DATCP within **15 business days** of decommissioning (i.e., within 15 days of the final pressure decay test). The contractor completing the work must certify that the appropriate decommissioning procedure was followed by signing the notification form. The notification form and checklist are available online at https://datcp.wi.gov/Pages/Programs_Services/PetroleumHazStorageTanksForms.aspx (look for "TR-WM-122"). A sample decommissioning checklist is available on **page 70** of this document.

Facilities are no longer required to notify DNR of the date and time of the final decommissioning test, and DNR no longer needs to witness the test.

Stage II System Maintenance—Facilities that choose to retain their Stage II systems must maintain and operate them in accordance with s. ATCP 93.230 (10), *Wis. Adm. Code*. DNR also recommends that facilities that have not decommissioned their Stage II systems maintain them according to the original requirements. See the section on best management practices below for facilities that choose to retain Stage II systems.

What are the remaining requirements for vapor controls for storage tank vent pipes?

Storage Tank Vent Pipes—Facilities in the former Stage II counties with a total storage tank capacity of 2,000 gallons or more are still required to have vapor controls on storage tank vent pipes. Section NR 420.035, *Wis. Adm. Code* requires:

- installing a pressure vacuum valve on the gasoline storage tank vent pipe
- the pressure vacuum valve be certified by the California Air Resources Board (CARB) and maintained in good working order

What are the best management practices for facilities that choose to retain Stage II systems?

Vapor Recovery System Requirements—DNR recommends that the vapor recovery system meet the following conditions:

- the type of vapor recovery system is certified by the California Air Resources Board to achieve 95 percent vapor recovery
- the system uses only coaxial hoses
- the system does not use remote check valves
- the system has been tested according to the rule's compliance testing requirements and the tests demonstrate that the system functions properly

System Operation Requirements—DNR recommends maintaining the vapor recovery system so that it is free of defects.

Weekly Inspections for Equipment Maintenance—DNR recommends weekly equipment inspections to ensure that the equipment is working properly. The inspections should include these areas:

- a visual inspection to ensure that flow shutoffs are working properly
- inspection of all boots, hoses, facecones and faceplates for tears or rips
- a visual inspection of all dispensing equipment for any gasoline leaks
- inspection of all delivery nozzles for tightness and bends which may impede vapor recovery

Wisconsin's Regulation for Control of Organic Compound Emissions from Petroleum and Gasoline Sources (continued)

This calendar contains a **Weekly Inspection Checklist on page 58** to facilitate the inspections. It can also be found online at <https://dnr.wi.gov/topic/SmallBusiness/documents/gasoline/WeeklyChecklist.pdf>. The “Weekly Inspection Record” on each month’s calendar page can be used to keep a log of facility inspections.

Employee Training—DNR recommends that owner-operators of facilities operating Stage II vapor recovery systems ensure that at least one employee receives training in system operation and maintenance.

If the only trained employee at a facility terminates employment, a new employee should receive training within 45 days. If the type of vapor recovery system at the facility changes, an employee should receive training before startup of the new system.

The calendar contains an **Employee Training Log on page 59** to help keep training records. It is also available online at <https://dnr.wi.gov/topic/SmallBusiness/documents/gasoline/TrainingLog.pdf>.

Posting Signs on Gasoline Dispensers—DNR recommends that facilities post clear instructions on gasoline dispensers showing:

- how to operate the vapor recovery system
- a warning not to top off fuel tanks

Annual System Testing—The requirement for annual testing of Stage II vapor recovery systems is no longer applicable, but testing is recommended by DNR as a best management practice. DNR no longer schedules or witnesses any annual testing.

What are the record keeping requirements in NR 420?

Gasoline dispensing facilities subject to the NR 420 vapor recovery requirements also have record keeping requirements. Records must be kept at the facility for a minimum of three years but should be kept for five years to comply with the more stringent federal regulations. The following records should be maintained:

- all permits or approvals that are necessary for operating the facility or the vapor recovery system
- the amount of gasoline dispensed at the facility on a monthly basis (see the Definitions section on **page 80** under the entry for “monthly throughput” for more information about DNR’s method for calculating throughput)
- an inspection and maintenance log that includes the name of the person conducting the inspection, the inspection date, a record of any defective part(s), the repair date and manufacturer’s part number
- not required but considered a best management practice—a permanent record of employee training that includes the name of the employee(s) who received training, dates of the training, amount of time (hours) spent in training and a list of the subject areas addressed

This calendar provides space to help facilities keep track of their gasoline throughput, equipment inspections, repairs and maintenance, and employee training. **Use this calendar to help meet record keeping obligations!**

For additional information about vapor recovery requirements and Stage II decommissioning...

Visit the Vehicles-mobile sources web page at <http://dnr.wi.gov/> (search “mobile sources”). The page includes a Stage II fact sheet, decommissioning Q&A and contact information found under the vapor recovery tab.

Wisconsin's Regulation for Control of Organic Compound Emissions from Petroleum and Gasoline Sources (continued)

What other regulations apply? What if the facility is located outside the designated counties?

Some gasoline dispensing facilities may also fall under Wisconsin's Control of Hazardous Pollutants rule (ch. NR 445, *Wis. Adm. Code*). Use the Throughput - 12 Month Rolling Totals worksheet on **page 61** to demonstrate compliance with NR 445. If your 12 month rolling total goes over 4.7 million gallons per year contact the DNR Air Program to determine your next steps to achieve compliance with NR 445.

NR 445 exemption levels

The following facilities are exempt from NR 445 requirements:

- facilities with Stage I vapor recovery that dispense less than 2 million gallons of gasoline per year
- facilities without Stage I vapor recovery that dispense less than 1.25 million gallons of gasoline per year

Facilities with throughput under these levels should keep monthly records to demonstrate that they are exempt.

Non-exempt facilities must meet NR 445 emissions standards for hazardous air pollutants, specifically benzene. The DNR has determined that facilities that currently dispense less than 4.7 million gallons of gasoline per year are compliant with the standards. These facilities must certify that throughput will remain below 4.7 million gallons in any 12 consecutive months by submitting a notification form to the DNR. A sample form is available at <http://dnr.wi.gov/> (search "gas stations" and scroll to the NR 445 section of the gas stations web page).

Facilities dispensing more than 4.7 million gallons per year may need to install vapor controls that reduce emissions below thresholds or that meet Lowest Achievable Emission Rate (LAER) technology standards. A facility that anticipates an annual throughput greater than 4.7 million gallons must provide emission estimates and propose controls or other limitations that demonstrate compliance with NR 445 or the appropriate LAER controls for DNR approval. Contact an air toxics staff member (visit <http://dnr.wi.gov/> and search "air toxics").

For more information about NR 445 requirements...

- Contact the Air Toxics staff member listed on the DNR's Air Toxics web page (visit <http://dnr.wi.gov/> and search "air toxics").
- Refer to the DNR fact sheet "Wisconsin HAPs Rule Requirements for Gasoline Dispensing Facilities" at <http://dnr.wi.gov/> (search "gas stations" and scroll to the NR 445 section of the Gas stations page).

Stage II Decommissioning Checklist

For reference only. The official notification form and checklist are available at <https://datcp.wi.gov/> (search “TR-WM-122”). **Make sure to follow DATCP’s Stage II decommissioning procedure as described on page 67 of this calendar.**

Note: Technician is expected to follow manufacturer’s decommissioning instructions where they exist.

| PEI 300-09 Reference | Decommissioning Activity | Completed |
|----------------------|--|-----------|
| 14.6.1 | Initiate safety procedures. | Y N/A |
| 14.6.2 | Relieve pressure in tank ullage. | Y N/A |
| 14.6.3 | Drain and purge Stage II system of liquid and vapors. Piping: <input type="checkbox"/> Disabled/plugged in place <input type="checkbox"/> Removed | Y N/A |
| 14.6.4/14.6.5 | Disconnect all vapor and processing units. Pump: <input type="checkbox"/> Disabled <input type="checkbox"/> Removed | Y N/A |
| 14.6.4 | Disconnect all electrical components of the Stage II system so that no electrical hazards are created. | Y N/A |
| 14.6.4 | Reprogram the dispenser to reflect that Stage II vapor recovery is no longer in service. <input type="checkbox"/> Electronics <input type="checkbox"/> Program software | Y N/A |
| 14.6.6 | Securely seal off the below-grade vapor piping at the height below the level of the base of the dispenser. | Y N/A |
| 14.6.7 | Securely seal off the below-grade vapor piping at the tank end if it is accessible. | Y N/A |
| 14.6.8 | Securely seal the vapor piping inside the dispenser cabinet. | Y N/A |
| 14.6.9 | Replace [all] Stage II hanging hardware with conventional hanging hardware. | Y N/A |
| 14.6.10 | Install appropriate pressure / vacuum vent valve(s). | Y N/A |
| 14.6.11 | Remove any Stage II instructions from the dispenser cabinet. | Y N/A |
| 14.6.12 | Conduct a pressure decay test to verify fittings are tight. Conduct a tie-tank test to verify vents are still functional. Attach test reports. | Y N/A |
| 14.6.13 | Verify that the visible components of the storage tank/dispensing system are left in a condition that will reliably prevent the release of any vapors or liquids from any component of the storage tank/dispensing system. | Y N/A |
| 14.6.13 | Restore the facility to operating status. | Y N/A |

Wisconsin's Flammable, Combustible and Hazardous Liquids Rule (ch. ATCP 93, *Wis. Adm. Code*)

The Wisconsin Department of Agriculture, Trade & Consumer Protection (DATCP) Weights & Measures Bureau regulates the storage of flammable, combustible and hazardous liquids through chapter ATCP 93 of the Wisconsin Administrative Code. This regulation protects the safety and health of the public and encompasses fire safety, life safety and environmental safety aspects for flammable, combustible and hazardous liquids including registration requirements for tanks that contain these liquids.

This calendar focuses on the rule's requirements specifically for **underground storage tanks (USTs) at gasoline dispensing facilities** (including gas stations). If a facility may be affected, be sure to read the full rule. More detailed information on this rule is available on the Hazardous Liquids Storage Tanks web page at <https://datcp.wi.gov/> (search "storage tanks").

This section of the calendar highlights specific parts of ATCP 93, including record keeping, reporting, leak detection, inventory verification, change of ownership, financial responsibility and training requirements. The summary outlined here can assist in complying with the UST requirements in the rule but should not be used solely to interpret the rule.

When does ATCP 93 affect a facility?

If the facility stores, handles and/or transports flammable, combustible and hazardous liquids, it is affected by this rule. In addition, owners/operators of 60 gallon and larger underground storage tanks and/or 5,000 gallon and larger aboveground storage tanks are regulated under ATCP 93. This includes any business that sells gasoline or other liquid motor fuel for use in any type of internal combustion engine.

How can this calendar help a facility comply with the regulations?

This calendar can help facilities meet many of the leak detection and record keeping requirements in ATCP 93. Forms for other reports and permit requirements may be obtained from DATCP's Weights & Measures Bureau.

Leak Detection Requirements

"Leak detection" refers to identifying whether a regulated substance has been discharged from a storage tank system into the environment or into the interstitial space between the storage tank system and its secondary barrier or secondary containment around it. The definition includes checking for leaks at least every 30 days. Owners/operators should maintain all records verifying leak detection efforts.

What are the requirements for detecting leaks?

All new and existing underground tank systems used to store regulated substances need to have a method of leak detection. This includes:

- equipment for measuring product levels that is used for manual tank gauging
- automatic tank gauging equipment
- interstitial monitoring equipment
- sensors used to detect leaks in tanks, lines or sumps

To maintain the effectiveness and accuracy of the leak detection equipment, annual verification and calibration of the leak detection equipment is required. Use the Annual Underground Tank System Functionality Verification form (TR- WM-139) for annual monitoring equipment certification. This form should be kept on site. The form can be accessed online at <https://datcp.wi.gov/> (search "TR-WM-139").

Can different leak detection methods be used?

ATCP 93 identifies the acceptable leak detection methods. Tanks should be monitored at least every 30 days for leaks using one of the following methods:

- Manual tank gauging (tanks with a capacity of more than 1,000 gallons may not use manual tank gauging as the sole method of required leak detection)
- Precision tightness testing
- Automatic tank gauging
- Statistical inventory reconciliation
- Interstitial monitoring

Wisconsin's Flammable, Combustible and Hazardous Liquids Rule (continued)

What are the leak detection requirements for piping?

Pressurized piping

Underground piping that conveys regulated substances under pressure should comply with the following requirements unless all of the piping is visible:

- The system should be equipped with an automatic line leak detector.
- Single-wall piping systems should have at least one of the following leak detection methods:
 - an annual precision tightness test
 - monthly monitoring to the 0.2 gallon per hour rate
- Double-wall piping systems should use at least one of the following leak detection methods:
 - an annual precision tightness test
 - monthly monitoring to the 0.2 gallon per hour rate
 - statistical inventory reconciliation (SIR), in conjunction with tank SIR
 - continuous interstitial monitoring
- If a passing test using monthly monitoring is not achieved for two consecutive months, perform a precision tightness test within 10 business days. If the piping fails to pass that test, assess the site for the presence of a release.

Suction piping

- Piping that conveys regulated substances under suction and that is not entirely visible should use one of the following leak detection methods:
 - a precision tightness test conducted at least every three years
 - interstitial monitoring
- Leak detection may be omitted for suction piping that meets all of the following requirements:
 - The below-grade piping operates at less than atmospheric pressure.
 - The below-grade piping is sloped so that the contents of the pipe will drain back into the storage tank if the suction is released.
 - Only one check valve is included in each suction line.
 - The check valve is visibly located directly below and as close as practical to the suction pump.
 - A method is provided that allows compliance to be readily determined.

More details on the leak detection requirements are contained in s. ATCP 93.510, *Wis. Adm. Code*.

Record keeping Requirements

What are the record keeping requirements for underground storage tanks and piping?

Operators of new and existing UST systems should maintain all of the following records:

- Documentation of any system repairs, alterations or upgrades, including software and hardware upgrades, and any inspections required under this chapter
- Documentation demonstrating conformance with leak detection requirements and the manner in which these claims have been justified or tested by the equipment manufacturer and certified installer, including all of the following:
 - Information pertaining to the leak detection system, including the material approval that was valid when the system was installed; operator manual; warranty; and documentation verifying that the equipment has been installed, programmed and tested to perform as required by the chapter
 - Testing results obtained from leak detection equipment, as from the equipment's printer or a hand-written log kept on site
 - Documentation maintained for all calibration, inspection, monitoring, testing, repair and annual performance verification of leak detection equipment permanently located on site (Underground Tank System Functionality Verification form, available at <https://datcp.wi.gov/> — search "TR- WM-139")
- Response to, and investigation of, leak detection alarms
- Documentation maintained for all calibration, inspection, monitoring, testing, repair and periodic performance verification of any corrosion protection equipment permanently located on site
- Analysis from a corrosion expert of site corrosion potential if corrosion protection equipment is not used
- Records of any environmental information that has accrued for a site, such as from site inspections or investigations; phase I or II environmental site

Wisconsin's Flammable, Combustible and Hazardous Liquids Rule (continued)

assessments; repairs; or tank system site assessments responding to leaks, spills, overfills, releases and tank closures

- Documentation of product inventory verification
- Results of functional testing of impact and emergency shut-off valves
- Electrical continuity testing for dispensers of motor fuels that are Class I liquids
- One set of stamped, approved plans and specifications and a copy of the approval letter
- Documentation of compliance with the compatibility requirements of ethanol or biodiesel blends, if applicable

Record Availability

What should a facility do with its records?

- Maintain the required records at the site.
- For unattended sites, make the records available for inspection at the site when given 72 hours prior notice.
- The approved plans, specifications and approval letter should be kept on site and available to DATCP during all phases of installation. After installation is completed, the approved plans, specifications and approval letter should be made available to DATCP upon request.
- Records may be kept electronically, provided they are in a format acceptable to the department.

How long must records be kept?

Although it is suggested that facilities maintain all of the UST records for the life of the facility, the following periods are specifically required by this rule. Records should be maintained for the specified periods from the date of the most recent test, inspection or upgrade:

- Monthly leak detection monitoring — one year
- Annual precision tightness testing — one year
- Periodic precision tightness testing in association with inventory control — until the next test is conducted
- Impressed current corrosion protection system 60-day inspection — the previous three inspections

Records that storage tank inspectors may request:

- Corrosion protection tests— sacrificial anode or impressed current (IC includes 60-day log)
 - Line tests
 - Tank tests
 - Flow restrictors
 - Internal inspections
 - Equipment calibration (form TR-WM-139, UST Functionality Verification)
 - Alarm history (includes how the person responsible responded)
 - Impact valves
 - Continuity tests
 - Inventory verification
 - Monthly inspection records
-
- Corrosion protection system annual test — the previous three tests
 - Internal inspection associated with underground tank lining — ten years
 - Annual performance verification of leak detection equipment and flow restrictor — two years
 - Results of functional testing of impact and emergency shut-off valves and electrical continuity testing for dispensers — two years
 - Owner's manual provided by the leak detection equipment manufacturer — until the leak detection system is replaced or no longer used
 - Any tank or pipe system modification or repair — life of the system
 - Inspection records — three years or the interval between required inspections, whichever is longer
 - Tank-system site assessments and other environmental assessments such as assessments for property transactions — three years after completion of any permanent closure, upgrade, repair or change in service; keep these records at one of the following locations:
 - with the owner or operator who took the UST system out of service
 - with the current operator of the UST system site
 - with the department if records cannot be maintained at the closed facility

Wisconsin's Flammable, Combustible and Hazardous Liquids Rule (continued)

- Leak detection alarm investigation — two years
- Product inventory verification — ten years
- One set of stamped, approved plans and specifications and a copy of the approval letter — life of the system
- Equipment or component compatibility for ethanol or biodiesel blends - life of the system

Note: All leak detection records should be retained permanently. The documentation could be helpful to exclude the site as a possible source of contamination later on.

Do facilities need to keep records showing they have petroleum products in their storage tanks?

Yes, if a petroleum product is stored, the facility must keep records demonstrating this. Petroleum products include, but are not limited to, gasoline, gasoline-alcohol fuel blends, kerosene, fuel oil, burner oil and diesel fuel oil.

What are the requirements for verifying and maintaining delivered petroleum products?

To verify and maintain the integrity of delivered products, conduct product inventory verification monthly for the life of the tank system, and also reconcile on a monthly basis, in the following manner:

- Inventory volume measurements for regulated substance inputs, withdrawals and the amount still remaining in the tank are recorded each operating day.
- The equipment used is capable of measuring the level of product over the full range of the tank's height, to the nearest one-eighth of an inch.
- The regulated substance inputs are reconciled with delivery receipts by measurement of the tank inventory volume before and after delivery. Where tanks are interconnected by a manifold, reconciliation may address all tanks as a group rather than as individual tanks.
- Product dispensing is metered and recorded according to requirements in ch. 92 for meter calibration or an accuracy of six cubic inches for every five gallons of produce withdrawn.

- The measurement of any water level in the bottom of the tank is made to the nearest one-eighth of an inch at least once a month.

Reconciliation must be used to determine if a leak detection method failed or an unauthorized product mixing occurred.

Spill and Overfill Prevention and Response

What are the requirements to prevent overfilling of storage tanks?

Prior to delivery, the operator of the fuel delivery equipment that is transferring the product should ensure that the volume available in the tank is greater than the volume of product to be transferred to the tank. The transfer operation should be monitored constantly by the operator of the delivery equipment to prevent overfilling and spilling. Fuel delivery persons should immediately inform the facility's owner or operator of any overfilling or spilling which occurs during delivery. The owner/operator of a retail fueling station should monitor the delivery procedure.

What are the equipment requirements?

All UST systems, whether new or existing, must have a liquid-tight containment system or spill bucket with a minimum capacity of five gallons.

The liquid-tight containment sump or spill bucket must be equipped with either a push-to-drain system that directs the spill into the tank or a mechanism to pump product out of the sump.

In addition, all new and existing UST systems must be equipped with storage tank overfill prevention equipment. The regulation requires dual overfill protection equipment that will:

- alert the transfer operator when the tank is no more than 90 percent full, by restricting the flow into the tank or triggering a high-level alarm
- automatically shut off flow when the tank is no more than 95 percent full

Wisconsin's Flammable, Combustible and Hazardous Liquids Rule (continued)

The deadline for existing tank systems to comply with this requirement was February 1, 2011; new systems must comply upon startup. More information on these requirements can be found in s. ATCP 93.505, *Wis. Adm. Code*.

Note that retrofit equipment is available that complies with these requirements and can be installed in a tank without removing pavement.

Pipe connections at the top of the tank and beneath pumps and dispensers must be in **secondary containment by January 1, 2022**.

What is required if a facility experiences a gasoline spill?

Immediately upon discovery of any evidence of a leak from a tank system or dispensing system, the owner or operator should take all measures necessary to stop the leak, mitigate fire and explosion hazards and prevent release of any free product into the environment. The facility also may be required to report the spill to the Wisconsin Department of Natural Resources (DNR). See the section on spill reporting on **page 79** for more information.

Annual Permit to Operate

What are the permit requirements for underground storage tanks?

All new and existing underground storage tanks must have a permit to operate issued by DATCP. A permit is required for each UST. Each permit to operate must be posted at the facility where the tank is located, and the permit should be visible to the public.

Permits are issued annually, and there is no fee. Permits expire yearly on the 28th day of the month specified in the initial permit. Permits also expire when a tank changes ownership. The Bureau of Weights & Measures storage tanks program sends out renewal notices and new permit applications before the existing permits expire.

To renew a permit, the tank owner should complete the permit application and return it to DATCP. Remember to include any required documentation with the application, including proof of financial responsibility (such as certificate of

insurance) and the affidavit of financial responsibility. A facility may also be asked to provide copies of equipment monitoring records and testing results. Use the permit renewal checklist below for documentation needed for the application.

Annual Tank Permits – Renewal Checklist

Make sure to include all the required documentation when sending in an application for a permit renewal. **Use this checklist to ensure a complete application!**

- Proof of financial responsibility (certificate of insurance and site schedule)
- Affidavit of financial responsibility, signed and notarized
- Details of leak detection method(s) used
 - ◆ tank monitoring
 - ◆ line monitoring
 - ◆ annual corrosion protection test results
 - ◆ annual leak detector test results
- Copies of monthly monitoring and annual testing results
- Corrections to any ownership or contact information that has changed
- If ownership has changed, include the change of ownership form and a copy of the deed
- **Sign and date the application**

Ownership and Insurance Information

What are the requirements for a change of ownership?

An individual or company taking ownership of property with a storage tank must notify DATCP of the change of ownership, including updated registration information and a permit application, within 15 business days of completing the real estate transaction. All records that have been retained should be transferred to the new owner or operator.

Wisconsin's Flammable, Combustible and Hazardous Liquids Rule (continued)

What are the financial responsibility requirements (also referred to as pollution insurance requirements) for owners?

All gasoline dispensing facilities must provide annual proof of financial responsibility in order to obtain a permit to operate. Financial responsibility means that the owner has sufficient financial backing to cover expenses due to cleanup or third-party liability that results from a leaking UST. Financial responsibility requirements vary depending on several factors. The amount of coverage a gasoline dispensing facility is required to have depends on the number of tanks owned and operated.

There are a number of mechanisms by which financial responsibility may be demonstrated. They include, but are not limited to, guarantees, insurance and risk retention group coverage, surety bonds, trust funds and local government funds (e.g. government bonds, financial tests, guarantees, etc.).

Owner-Operator Training Requirements in Wisconsin's ATCP 93 Rule

Why conduct operator training?

Section 1524 of the Energy Policy Act of 2005 required the U.S. Environmental Protection Agency (U.S. EPA) to establish training requirements for the people responsible for operating and maintaining UST systems. Wisconsin's ATCP 93 subchapter VIII incorporates U.S. EPA owner-operator training requirements.

Training is available for all three classes of operators who are involved in operating and maintaining these storage tank systems. See the table on the following page for information about the roles of Class A, B and C operators and a summary of the training requirements.

What are the training requirements?

Operator training includes an evaluation of an operator's knowledge of applicable requirements. The method for meeting the requirements for Class A and B operators includes written proof of successful completion of an operator training and testing program that has received prior approval from DATCP.

Class C operators must obtain training and a certificate from the accredited Class A or Class B facility operator where the Class C operator is employed or a department-approved training program showing that the Class C operator has successfully completed training for the facility.

When is the training required?

New or existing UST systems must have a Class A operator, a Class B operator and a Class C operator designated, and these operators must be trained. Class A and B operators must be trained within 30 days of assuming their responsibilities at a facility. Class C operators must be trained before assuming their responsibilities.

Where can an employee find approved trainings?

DATCP has approved a number of Class A, B and C training providers. For the most current list of approved UST operator trainers and testing vendors, refer to the Operator Training Requirements link on DATCP's Hazardous Liquids Storage Tanks web page (visit <https://datcp.wi.gov/> and search "A/B/C Operator Training Requirements" for a list of trainers and links to courses they offer.

What are the record keeping requirements?

The owner or operator must maintain documentation of designated operators and their training at the UST system site and have it immediately available for inspection by DATCP. The onsite records must identify all Class A, Class B and Class C operators currently designated for the facility. The list must include the operator's name, address, phone number, class, date duties were assumed, date of each completed initial training and any retraining. Training certificates must also be available for inspection.

This calendar contains a training log on **page 59** that provides space for recording designated Class A, B and C operators and keeping track of operator training. Use the log to help organize training records and meet record keeping requirements.

Are there retraining requirements?

Yes. If DATCP determines that a UST system is not in compliance or exhibits a continuing pattern of noncompliance, the department may require the Class A, Class B or Class C operator to be retrained within 30 days.

Where can more information be found about this training requirement?

The Bureau of Weights & Measures storage tanks program has information about the training requirements, including frequently asked questions, available at the "A/B/C Operator Training Requirements" link on DATCP's Hazardous Liquids Storage Tanks web page. Questions can also be directed to DATCP at 608-224-4942.

U.S. EPA has background information about the operator training requirements available at <https://www.epa.gov/ust/underground-storage-tank-operator-training-2005-energy-policy-act>.

Owner-Operator Training Requirements in Wisconsin's ATCP 93 Rule (continued)

Classes of Operators that Require Training and Training Requirements

| | Class A Operator | Class B Operator | Class C Operator |
|--|---|--|---|
| Who fits this class of operator? | The individual who generally focuses on the statutory and regulatory requirements related to operating and maintaining the UST system (e.g. owner, environmental manager) and also manages resources and personnel, such as establishing work assignments to achieve and maintain compliance with regulatory requirements. | The individual who is generally responsible for field implementation of applicable UST regulatory requirements and who implements day-to-day aspects of operating, maintaining and record keeping for underground storage tanks at one or more facilities (owner, facility manager). | The individual responsible for initially addressing emergencies presented by a spill or release and for controlling and monitoring the dispensing and sale of fuel. |
| What is the objective of the training requirements? | Ensure broad knowledge of regulatory requirements. | Ensure in-depth knowledge of implementing regulatory requirements. | Ensure knowledge of actions to take in the event of a leak or other emergency. |
| What does the training include (at a minimum)? | <ul style="list-style-type: none"> • Spill prevention • Overfill prevention • Release detection • Corrosion protection • Emergency response • Product compatibility • Financial responsibility • Notification requirements • Release and suspected release reporting • Temporary and permanent closure requirements • Operator training requirements | <ul style="list-style-type: none"> • Spill prevention • Overfill prevention • Release detection • Corrosion protection • Emergency response • Product compatibility • Reporting and record keeping requirements | <p>Emergency response procedures, including all of the following:</p> <ul style="list-style-type: none"> • Procedures for overfill protection during fuel delivery • Operation of emergency shut off systems • Appropriate response to all alarms • Reporting of leaks, spills, releases • Site specific emergency procedures • Name and contact information of the appropriate parties to be notified of a leak, spill, release or alarm |

Spill Reporting Requirements and Procedures

Some aspects of spill response, especially spill reporting, are governed by requirements in other state and federal regulations. This is a brief summary of those requirements.

When must a spill be reported?

All spills need to be cleaned up. Many spills need to be reported to the DNR. Wisconsin statutes do allow de minimis exemptions for small quantity spills that meet certain criteria. Both the characteristics of the spill and amount of spilled substances are considered when determining reporting requirements.

The de minimis exemption for petroleum compounds applies **only** when the discharged substance:

- has evaporated or been cleaned up in accordance with state law
- does not adversely impact or threaten to adversely impact the air, lands and waters of the state as a single discharge or when accumulated with past discharges
- does not cause or threaten to cause chronic/acute human health impacts
- does not present or threaten to present a fire, explosion or other safety hazard

Petroleum discharges do not require notifying DNR if the spill meets the de minimis conditions above and the quantity spilled is:

- gasoline or another petroleum product that is completely contained on an impervious surface
- less than one gallon of gasoline onto a pervious surface or running off an impervious surface
- less than five gallons of other petroleum products onto a pervious surface or running off an impervious surface

Any spill with quantities less than the amounts mentioned above and that meets the de minimis conditions is exempt from requirements to report to the DNR. However, Weights & Measures petroleum system inspectors can still report spills if they see staining under dispensers because the spill has not been cleaned up, so it is important to have good housekeeping and spill prevention measures in place.

If a spill is not exempt, report the spill to **Wisconsin's Emergency Hotline at 800-943-0003**. This is a 24 hour per day, 7 day per week phone number. The owner and operator are responsible for reporting.

Penalties exist for failing to provide notice of reportable spills. Therefore, if in doubt about the quantity spilled, reporting is recommended. For more information about spills, visit the DNR's website at <http://dnr.wi.gov/> (search "spills").

Is additional reporting required?

Certain spills trigger the federal Emergency Release Notification requirements in section 304 of the Emergency Planning and Community Right-to-Know Act. The Department of Energy's Office of Health, Safety & Security has an online Reportable Quantities (RQ) Calculator at <http://energy.gov/ehss/reportable-quantity-calculator> to check reportable quantities and evaluate whether a release must be reported to the National Response Center.

Who is the contact if additional reporting is required?

To report a spill that exceeds reportable quantities of a federally listed hazardous substance(s), make the following three telephone calls:

- Wisconsin Emergency Hotline, 800-943-0003 (same as above)
- National Response Center, 800-424-8802
- Local Emergency Planning Committee (LEPC) at the county's Emergency Management Office (each county in Wisconsin has one)

Definitions

This section contains definitions and information about many of the terms that appear in the three rules addressed in this calendar.

Ambient air—any unconfined portion of the atmosphere: open air, surrounding air.

Area source—a facility that emits less than ten tons per year of a single hazardous or toxic air pollutant (HAP), or less than 25 tons per year of any combination of HAPs.

Bottom filling—filling a tank truck or stationary storage tank through an opening that is near or flush with the tank bottom.

California Air Resources Board certified—a vapor recovery system or system component that has been certified by the California Air Resources Board pursuant to section 41954 of the California health and safety code.

Delivery vessel—a tank truck, tank trailer or railroad tank car equipped with a storage tank used for transporting gasoline from sources of supply to stationary storage tanks at gasoline dispensing facilities.

Dual-point vapor balance system—a type of vapor balance system in which the storage tank is equipped with an entry port for a gasoline fill pipe and a separate exit port for a vapor connection.

Gasoline—any petroleum distillate or petroleum distillate/alcohol blend having a Reid vapor pressure of 27.6 kilopascals or greater that is used as a fuel for internal combustion engines.

Gasoline cargo tank—a delivery tank truck or railcar that is loading or unloading gasoline or that has loaded or unloaded gasoline on the immediately previous load.

Gasoline dispensing facility (GDF)—any stationary facility that dispenses gasoline into the fuel tank of a motor vehicle, motor vehicle engine, nonroad vehicle or nonroad engine, including a nonroad vehicle or nonroad engine used solely for competition. These facilities include, but are not limited to, facilities that dispense gasoline into on- and off-road, street or highway motor vehicles; lawn equipment; boats; test engines; landscaping equipment; generators; pumps and other gasoline-fueled engines and equipment.

Inventory controls/inventory verification—techniques used to identify a loss of product that are based on volumetric measurements in the tank and reconciliation of those measurements with product delivery and withdrawal records.

Leak detection—determining whether gasoline has been discharged from a storage tank system into the environment or into the interstitial space between the storage tank system and its secondary barrier or the secondary containment around it. Leak detection requirements include verifying that a tank is not leaking at least every 30 days; the owner or operator must maintain a record of the verification.

Leaking component—any component that has a VOC concentration exceeding 10,000 ppm when tested in the manner approved by the Wisconsin DNR.

Liquid tight—having a liquid leak rate not exceeding 0.10 gallons per hour when measured with five percent accuracy.

Monthly throughput—the total volume of gasoline that is loaded into, or dispensed from, all gasoline storage tanks at each gasoline dispensing facility (GDF) during a month. The definitions of throughput in the federal U.S. EPA rule and Wisconsin's NR 420 differ:

- In the federal rule, U.S. EPA requires that monthly throughput be calculated by summing the volume of gasoline loaded into, or dispensed from, all gasoline storage tanks at each GDF during the current day, plus the total volume of gasoline loaded into, or dispensed from, all gasoline storage tanks at each GDF during the previous 364 days, and then dividing that sum by 12. (The details are outlined in the definitions section of the rule, 63.11132.)
- In Wisconsin's ch. NR 420, DNR defines average monthly throughput as the amount of gasoline dispensed per month, on average, for any 24 month period beginning with calendar years 1991 and 1992. Any period of time when the facility was non-operational must be excluded from the calculation. The details are outlined in s. NR 420.045(1)(c), *Wis. Adm. Code*.

Motor vehicle—a self-propelled vehicle designed for transporting persons or property on a street or highway.

Definitions (continued)

Nonroad engine—an internal combustion engine (including the fuel system) that is not used in a motor vehicle or a vehicle used solely for competition, or that is not subject to standards promulgated under section 7411 or section 7521 of USC Title 42.

Nonroad vehicle—a vehicle that is powered by a nonroad engine and that is not a motor vehicle or a vehicle used solely for competition.

Reconstruction—the replacement of components at a facility to an extent that (1) the fixed capital cost of the new components exceeds 50 percent of the fixed capital cost that would be required to construct a comparable new source; and (2) it is technologically and economically feasible for the reconstructed source to meet the relevant standard(s) established by U.S. EPA or Wisconsin DNR. Upon reconstruction, an affected source, or a stationary source that becomes an affected source, is subject to relevant standards for new sources, including compliance dates.

Stage I vapor recovery—a control method that captures gasoline vapors released when gasoline is delivered to a storage tank. The vapors are returned to the tank truck as the storage tank is filled with fuel rather than being released to the ambient air. Then the vapors can be transported back to the terminal vapor processor for recovery or destruction.

Stage II vapor recovery—a control method that captures gasoline vapor that would otherwise escape into the air when motorists refuel their vehicles. The vapors are returned through the pump hose to the petroleum storage tank.

Submerged filling—filling a gasoline storage tank through a submerged fill pipe or drop tube with a discharge that is within the applicable distance from the bottom of the tank as specified in the federal NESHAP (6 inches for pipes installed after November 9, 2006 and 12 inches for pipes installed on or before that date). Bottom filling of gasoline storage tanks is included in this definition.

Top off—to attempt to dispense more gasoline to a motor vehicle fuel tank after the vapor recovery dispensing nozzle has shut off.

Vapor balance system—a combination of pipes and hoses that create a closed system between the vapor spaces of an unloading gasoline cargo tank and a receiving storage tank such that vapors displaced from the storage tank are transferred to the gasoline cargo tank being unloaded.

Vapor control or vapor recovery system—a system that gathers organic compound vapors released during the operation of any transfer, storage or process equipment and processes the vapors so as to prevent their emission into the ambient air.

Vapor recovery assist system—a vapor control system that employs a pump, blower or other vacuum-inducing device to collect or process vapors generated during motor vehicle fueling operations.

Vapor tight—when equipment allows no loss of vapors. Compliance with vapor-tight requirements can be determined by checking to ensure that the concentration of vapors at a potential leak source does not exceed specified limits when measured at a distance of one inch from the source.

Vapor-tight gasoline cargo tank—a gasoline cargo tank that has demonstrated within the 12 preceding months that it meets the annual certification test requirements that are specified in the federal NESHAP (section 63.11092(f)).

Sources of Information

Wisconsin Department of Natural Resources

- **Small Business Environmental Assistance Program website:** factsheets, regulatory tools and a toll free helpline - visit <http://dnr.wi.gov/> and search “small business.”
- **Gas stations web page:** visit <http://dnr.wi.gov/> and search “gas stations.”
- **Staff contacts:** contact the staff member listed on the Air Management Program's Vehicles - mobile sources web page (visit <http://dnr.wi.gov/> and search “mobile sources”). For questions about NR 445, search “air toxics” to find a staff member listed on the page.
- **Employee training:** for DNR approved employee training, contact Wisconsin Petroleum Marketers at 608-256-7555 or <http://www.wpmca.org/>.

Wisconsin Department of Agriculture, Trade & Consumer Protection

- **Weights & Measures Bureau:** visit <https://datcp.wi.gov/> and search “weights & measures.”
- **Hazardous Liquids Storage Tanks web page:** visit <https://datcp.wi.gov/> and search “storage tanks.”
- **Staff contacts in the Weights & Measures Storage Tank program:** see the map on **page 83** or view the map online at https://datcp.wi.gov/Pages/Programs_Services/WeightsAndMeasuresContacts.aspx.
- **Forms:** see the “storage tank forms” link on the Storage Tanks web page for forms related to tank registration, installation, inspection, maintenance, Stage II decommissioning, operator training and other topics (or visit <https://datcp.wi.gov/> and search “storage tank forms”).
- **Operator training:** visit <https://datcp.wi.gov/> and search “operator training”.
- **Inspection and maintenance procedures:** publications detailing recommended practices for storage tanks (RP 900) and fuel dispensing equipment (RP 500) are available from the Petroleum Equipment Institute at <http://www.pei.org/>.

Wisconsin Department of Revenue

- **Motor Fuel Tax:** <https://www.revenue.wi.gov/Pages/Businesses/MotorFuel.aspx>

Wisconsin Administrative Code

- **Wisconsin Legislative Documents website:** refer to the Administrative Rules section at <http://docs.legis.wisconsin.gov/> to obtain official copies of the state rules referenced in this calendar.

U.S. Environmental Protection Agency


- **Office of Underground Storage Tanks:** <https://www.epa.gov/ust>
- **Owner-operator training:** <https://www.epa.gov/ust/underground-storage-tank-operator-training-2005-energy-policy-act>

Additional Resources

- **American Petroleum Institute (API):** <http://www.api.org/>
- **American Society of Testing and Materials (ASTM):** <http://www.astm.org/>
- **Axxis:** <http://www.axxispetro.com/>
- **Fiberglass Tank and Pipe Institute (FTPI):** <http://www.fiberglasstankandpipe.com/>
- **NACE International—The Corrosion Society:** <http://nace.org/home.aspx>
- **NACS, the Association for Convenience and Fuel Retailing:** <http://www.nacsonline.com/Pages/default.aspx>
- **National Association of Truck Stop Operators (NATSO):** <http://www.natso.com/>
- **National Fire Protection Association (NFPA):** <https://www.nfpa.org/>
- **Petroleum Equipment Institute (PEI):** <http://www.pei.org/>
- **Petroleum Marketers Association of America (PMAA):** <http://www.pmaa.org/>
- **Society of Independent Gasoline Marketers of America (SIGMA):** <https://www.sigma.org/>
- **Steel Tank Institute (STI):** <http://www.steeltank.com/>
- **Underwriters Laboratories (UL):** <http://www.ul.com/>
- **US Department of Energy, Energy Information Administration petroleum site:** <http://www.eia.gov/>
- **Wisconsin Petroleum Marketers & Convenience Store Association (WMPCA):** <http://www.wpmca.org/>.

Petroleum Inspection Districts

Weights and Measures General Inspection Territories October 2020

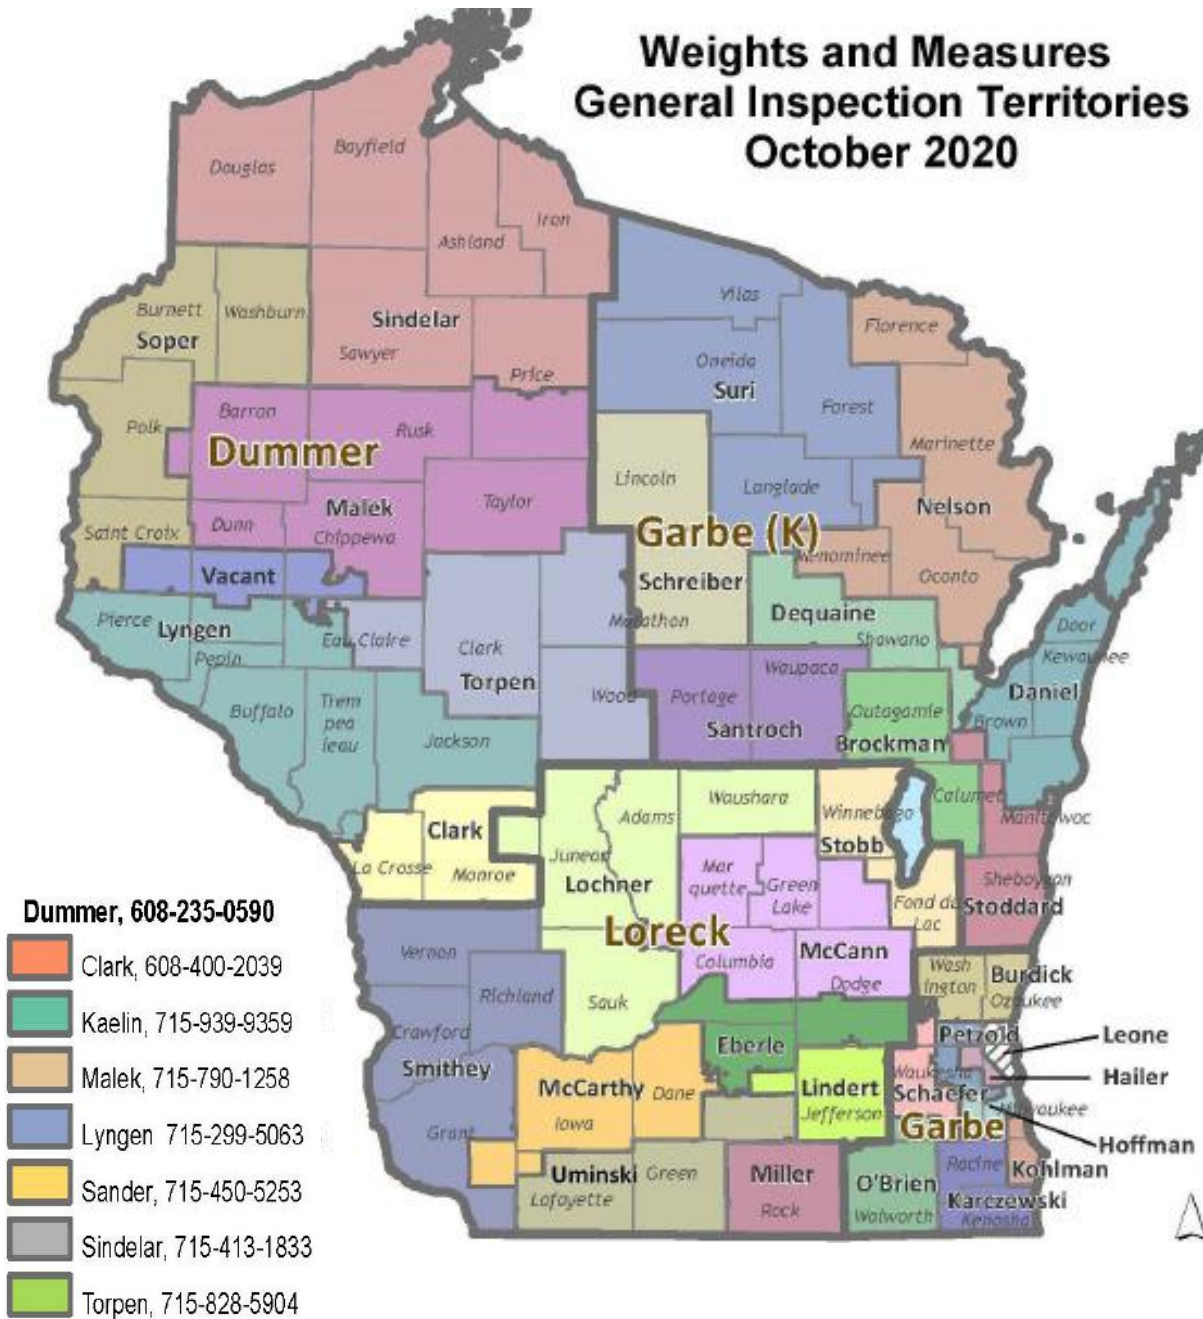

Mailing address for all districts:

DATCP
2811 Agriculture Dr.
PO Box 8911
Madison, WI 53708-8911
(608) 224-4942

DATCPWeightsAndMeasures@wisconsin.gov

Note: The map, phone numbers and contacts can change. An up-to-date map can be viewed on DATCP's website at: https://datcp.wi.gov/Pages/Programs_Services/WeightsAndMeasuresContacts.aspx.

Assistance Available for Gasoline Dispensing Facilities



Wisconsin Department of Agriculture, Trade & Consumer Protection (DATCP)

Weights & Measures Bureau

The Weights and Measures Bureau is the primary unit responsible for the administration and regulation of ch. ATCP 93, *Wis. Adm. Code*—the Flammable, Combustible and Hazardous Liquids Rule. For more information about the Weights & Measures Bureau, visit <https://datcp.wi.gov/> (search “weights & measures”). Additional information is available on DATCP’s Hazardous Liquids Storage Tanks web page (search “storage tanks”).

Wisconsin Department of Natural Resources (DNR)

Small Business Environmental Assistance Program (SBEAP)

SBEAP provides non-regulatory information to Wisconsin small businesses to help them understand their environmental compliance requirements. The program has fact sheets, record keeping and reporting tools, U.S. EPA compliance documents and DNR required forms and permit applications, all available free of charge. For more information, contact SBEAP at 855-889-3021, email the program at DNRsmallbusiness@wi.gov, or visit <http://dnr.wi.gov/> (search “small business”).

Air Management Program

The Air Management Program administers ch. NR 420, *Wis. Adm. Code*—Control of Organic Compound Emissions from Petroleum and Gasoline Sources, and ch. NR 445, *Wis. Adm. Code*—Control of Hazardous Pollutants. For more information about the Air Management Program, visit <http://dnr.wi.gov/> and search “air quality”. Staff contacts for vapor recovery requirements (NR 420) and air toxics requirements (NR 445) can be found on the Air Management Program web pages: visit <http://dnr.wi.gov/> (search “mobile sources” and “air toxics”).

Wisconsin Petroleum Marketers and Convenience Store Association (WPMCA)

WPMCA represents more than 2,000 independently owned and operated stations and stores throughout the state. WPMCA keeps its members informed about issues that are relevant to the industry, helps members share useful information, reinforces the importance of independent businesses in our communities and educates policy makers about the industry’s needs. WPMCA also offers various environmental training programs for compliance with rules like ATCP 93 and NR 420. To learn more, call 608-256-7555 or visit <http://www.wpmca.org/>.

